

LightRules

Admin Guide Version 2.11



**DIGITAL
LUMENS**

Copyright

All Rights Reserved © 2010-2015, Digital Lumens Incorporated

All material subject to change without notice.

LightRules® is a registered trademark of Digital Lumens.

table of contents

Copyright	0
Chapter One:	1
LightRules Overview	2
Minimum Browser Requirements	2
Reader Feedback	2
Technical Support Contacts	3
LightRules New Features	3
Logging in	4
New Account Registration	4
Account Login	5
Resetting Your Password	5
Software Features	5
Dashboard	6
Facility Map	7
Configuration	8
Calendar	9
Manual Control	10
Comparative Analysis	11
Reporting	11
Administration	12
Hardware Components	12
Example System Diagram	13
Add a Monitor, Keyboard, or Mouse	14
User Permissions	15
Commissioner Software	15
Contact Digital Lumens Technical Support	16
Chapter Two:	17
LightRules Quickstart Guide	18
Logging in	18
Facility Map	19
Using Manual Control	24
Using Automatic Control	25
Creating a Zone	26
Creating a Profile	28
Performing a Sync	29
Basic Diagnostics	29
Chapter Three:	31
Manual Control	32

Overview	32
Manual Control Tasks	32
Push an Existing Manual Profile	32
Create a new Manual Profile	32
Active Profiles Display	34
Clone a Manual Profile	34
Edit a Manual Profile	34
Cancel a Manual Profile	35
Expiration Settings	35
Chapter Four:	37
Calendar Control	38
Calendar Control Tasks	38
General Strategy for Creating a Lighting Schedule	38
Reviewing the Calendar	38
Using the Calendar to Schedule a Block	40
Using the Calendar to Edit a Block	41
Deleting a Block	42
Chapter Five:	43
Reporting	44
Standard Report Templates	44
Reporting Theory of Operation	44
Creating New Reports	45
Graph Reports	45
Working with Graph Reports	46
Running Graph Reports	46
Tips for Viewing Reports	46
Filter a Report By Room	47
Filter a Report By Zone	47
Edit a Report Template	48
Create a New Report Template	48
Clone an Existing Report Template	49
Delete a Report Template	49
Add a Report Template to the Favorites List	49
Run an Energy Cost Report	49
Run an Energy Usage Report with Daylight Harvesting Data	50
Facility Map Reports	50
Working with Facility Map Reports	51

Running Facility Map Reports	51
Tips for Viewing Reports	51
Facility Map Controls	51
Adjust the Facility Map Color Scheme	52
Adjust the Facility Map Data Radius	53
Chapter Six:	55
Configuration	56
Typical Configurations	56
Working with Zones	57
Creating a New Zone	57
Editing an Existing Zone	58
Merging Two Zones	58
Splitting a Zone	59
Working with Profiles	59
Creating a New Profile	60
Creating a New Facility-wide Profile	61
Editing or Cloning an Existing Profile	61
Deleting a Profile	61
Edit Light Settings	61
Move a Light to a Different Zone	62
Rename a Light	62
Disable Control	62
Daylight Harvesting-Enabled Lights	62
Step 1: Enable Daylight Harvesting at the Global Level	62
Step 2: Enable Daylight Harvesting at the Fixture Level	63
Disable Daylight Harvesting at the Profile Level	63
Coordinated Control Lights	63
Step 1: Enable Coordinated Control at the Global Level	63
Step 2: Enable Coordinated Control at the Zone Level	64
Step 3: Designate a Light as a Coordination Master	64
Disable Coordinated Control at the Profile Level	64
Edit Rooms	64
Create a New Room	64
Edit an Existing Room	65
Working with Control Stations (NEW)	65
Identifying Areas and Control Stations	65
Enabling Control Stations	66
Adding Control Station Users	66
Creating Control Stations	68
Deleting Control Stations	70

Starting an Override	71
Canceling an Override	72
Manage the Map File	72
Downloading the Map File	73
Back up the Current Map File (NEW)	73
Uploading the Map File	73
Perform a Sync	73
Syncing the Map File	74
Chapter Seven:	75
Analysis	76
How it Works	76
Running a What-if Report	77
Chapter Eight:	79
Administration	80
Administrative functions	80
User Accounts	80
Create a User Account	80
Edit an Existing User's Permissions	81
Change a User's Password	81
Delete a User Account	81
Edit Settings	81
Editing General Settings	82
Editing Date and Time Settings	83
Email Server Settings	84
Editing Networks and Firmware	84
Battery Backup Tests (NEW)	85
Start a battery backup test now	85
Schedule a battery backup test for later	86
Download battery backup test reports	88
Backup and Restore	88
Backup Process	89
Restore Process	89
Enable Site Configuration (NEW)	89
Upload Product Profile	90
Shutdown	90
Chapter Nine:	91
Diagnostics	92

Diagnostic Alerts	92
Diagnostic Actions	93
Discover Feature	93
Discover a New Light	94
Discover a New Gateway	94
Discover a New Keypad	94
Discover a New Power Gateway	94
Chapter Ten:	97
LightRules Add-on Features	98
LightRules Power	98
Working with LightRules Power	98
Configuration in Commissioner	98
Configuration in LightRules	98
Create a New Meter Group	99
Assign a Power Meter to a Meter Group	99
Move a Power Meter to a Different Meter Group	99
LightRules Power Reporting	100
LightRules Power Reporting Overview	100
Filter a Report By Meter Group	100
Edit a Metered Power Report Template	101
Create a New Template	101
Clone an Existing Template	101
Delete a Metered Report Template	101
LightRules Keypad	102
Working with Keypads	102
Configuration in Commissioner	102
Configuration in LightRules	102
Control a Keypad via LightRules	102
Cancel a Keypad-Activated Manual Profile	103
Edit Keypad Button Assignments	103
Edit Keypad General Settings	104
Chapter Eleven:	107
Example Cases	108
Calendar Example Cases	108
Example Case 1: Scheduling Lights to All On	108
Example Case 2: Scheduling Weekend Night Lights	108
Example Case 3: Scheduling Maintenance in One Room for the Following Week	109

Configuration Example Cases	109
Example Case 1: Designing Profiles	109
Example Case 2: Designing Zones	110
Example Case 3: Typical Profiles	110
Manual Control Example Cases	112
Example Case 1: Temporarily Turning Lights All On	112
Example Case 2: Power Limiting	112
Example Case 3: Fine-tuning Night Lights to Improve the Facility's Energy Efficiency	113
Reporting Example Cases	114
Example Case 1: Using Reports to Improve the Facility's Energy Efficiency: Active Power	114
Example Case 2: Using Reports to Improve the Facility's Energy Efficiency: Sensor Delay	114

Chapter One:

LightRules Overview

LightRules Overview

LightRules is the lighting management system designed for use with intelligent LED light fixtures and light agents from Digital Lumens. LightRules transforms a commercial or industrial building's lighting system into a network of lights capable of dramatically improving energy efficiency.

In addition to basic lighting operations like dimming and occupancy sensing, LightRules also gives you:

- A dashboard-style web interface
- Scheduled lighting management
- Manual light control
- Detailed energy usage, energy cost, and occupancy reporting
- Interactive control via a facility map
- Integration with daylight harvesting-enabled lights
- Lighting safety controls

For more information on LightRules basics, please see the following:

- "LightRules New Features" (see page 3)
- "Logging in " (see page 4)
- "User Permissions" (see page 15)
- "Software Features" (see page 5)
- "Hardware Components" (see page 12)

Minimum Browser Requirements

LightRules is compatible with the following web browser versions (and newer):

- Internet Explorer 9
- Chrome 7
- Firefox 12
- Safari 5.1

Reader Feedback

Your feedback could be instrumental in changing the text included in this help system.

If you can offer any technical or general suggestions, email a note to the following address:

documentation@digitallumens.com

Technical Support Contacts

For support beyond the scope of this technical documentation, contact Digital Lumens technical support via email: support@digitallumens.com

In case of emergency, if you need immediate assistance, please contact Digital Lumens technical support by telephone at: **+1 (617) 723-1200, extension 3**.

If you are a partner, to open a support ticket, go to digitallumens.zendesk.com. Once you've created an account, you'll have full access to partner content and technical support features.

LightRules New Features

The following new feature additions and enhancements are available in LightRules version 2.11:

New Features

LightRules now supports the following:

- **Control Stations** — Administrators can now create Station Operator users and setup control stations for their use. These users can then start and cancel overrides using control stations. For more information, go to "Working with Control Stations (NEW)" (see page 65).
- **Battery Backup Testing** — Battery Backup tests allow administrators to test emergency lighting on an interim or scheduled basis to ensure the safety of facilities and employees in the event of a power outage or emergency. For more information, go to "Battery Backup Tests (NEW)" (see page 85).


Enhancements

- **NTP** — The Network Time Protocol is a system for synchronized timekeeping for computers connected to the Internet. NTP date and time settings are now available in LightRules. For more information, go to "Editing Date and Time Settings" (see page 83).
- **DNS Configuration** — During installation, for instructions on configuring network settings and firmware, refer to the [LightRules Appliance Installation Instructions](#) document available on Zendesk (you must have a Zendesk account and be signed in to view this document).
- **TLS Web Connections** — During installation, for instructions on applying TLS Web Connections, refer to the [LightRules Appliance Installation Instructions](#) document available on Zendesk (you must have a Zendesk account and be signed in to view this document).
- **Standalone console mode** — This option allows administrators to simplify configuration of the LightRules appliance when you are not connected to a corporate enterprise network. For more information, refer to the [LightRules Appliance Installation Instructions](#) document available at Zendesk (you must have a Zendesk account and be signed in to view this document).

Logging in

New Account Registration

When the system admin sets up your account, LightRules automatically generates and sends you an email with confirmation instructions:

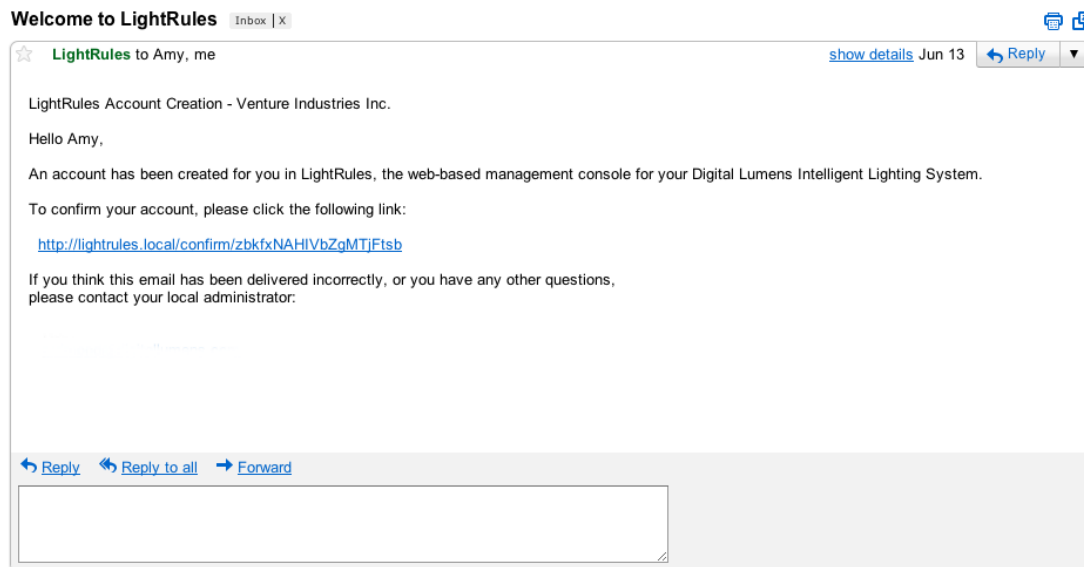

1. Click the link in the email.
2. Enter the desired password in the top field. Your password must contain at least four characters or digits.
3. Enter your password a second time in the bottom field.
4. Click **Change Password**.
5. Read the End-User License Agreement (EULA) and then click **I Agree**.



Note: If your network configuration is stand-alone (the LightRules appliance is not connected to the facility's enterprise network), the system admin will create your password during account creation.

Account Login



Login

Please log in

Email*

Password*

[Reset forgotten password](#)

1. Open the Login screen by clicking the link in the new account email you received from LightRules.
2. For future use, create a bookmark to the link in your web browser.
3. Enter your email address and password.
4. Click **Log In**.

i **Tip:** During installation, if a default email domain has been configured, then LightRules accepts the first part of a user's email address as a valid login. For example, if the email address is "amy.jones@ventureindustries.com" that user can log in using either of the following: **amy.jones@ventureindustries.com** or **amy.jones**


Resetting Your Password

1. At the Login screen, click **Reset forgotten password**.
2. At the Reset Password screen, type your email address, and then click **Reset Password**.
3. Open the auto-generated email from LightRules and click the link.
4. Enter your new password in the top field.
5. Enter the password a second time in the bottom field.
6. Click **Change Password**.

Software Features


The following features make up LightRules software:

Dashboard

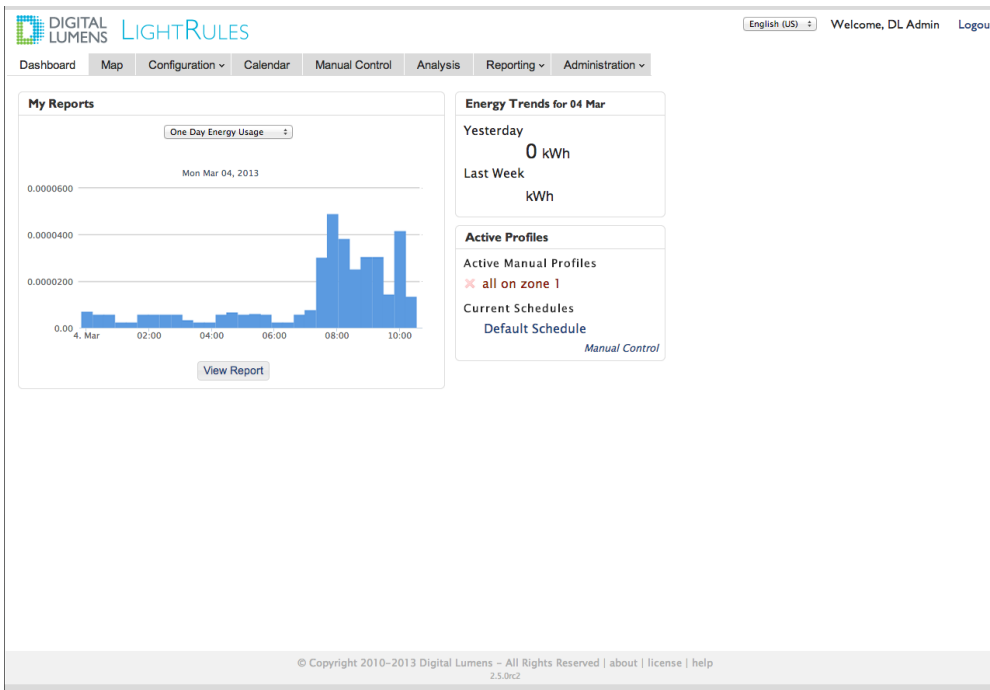

The LightRules interface is accessible via any web browser connected to the facility’s enterprise network. Following login, the LightRules dashboard appears, providing at-a-glance reporting, energy usage information, and instant access to manual light control. The user can also cancel a Keypad-activated profile via the dashboard:

Facility Map

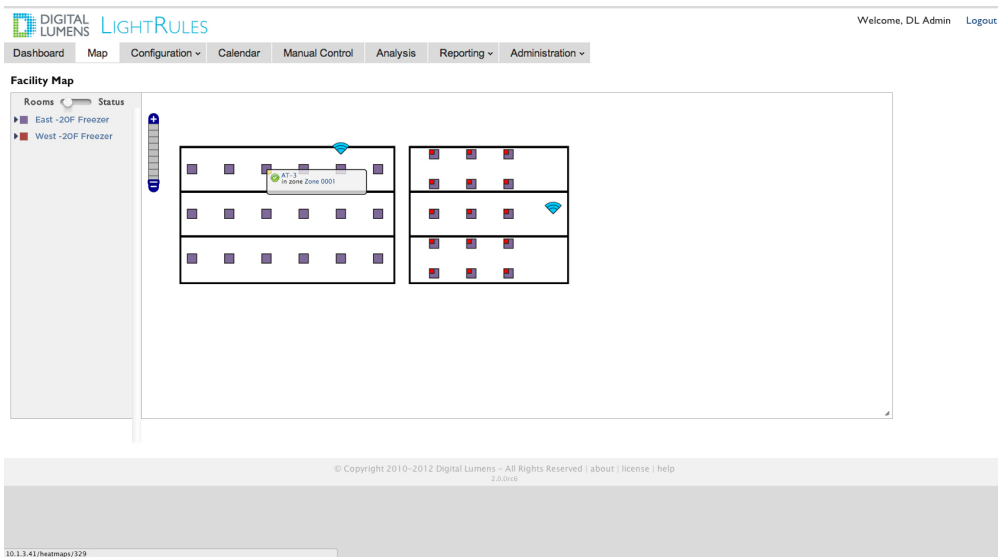

Click the **Map** tab to open the facility map, which displays lighting system information as an overlay on the facility floor plan. With the map, you can

- view all of the lights, gateways, keypads, power meters, and power gateways in the facility, in their actual locations,
- toggle between the room/zone assignments and the color-coded statuses of all lights and gateways,
- zoom in and out to the desired level of detail,
- quick-view individual light details,
- ping lights, gateways, keypads, power meters, and power gateways, and
- access settings.



Note: To use the facility map feature in LightRules, the map file created with Commissioner software must contain the facility drawing (typically a PNG file).

Configuration

English (US) Welcome, John Smith Logout

Dashboard Map Configuration Calendar Manual Control Analysis Reporting Administration

Network C13

Gateway: 0201039D
Ip Address: 192.168.1.103
Wireless Status: Network formed
Gateway Type: Type 2

Panid: 50C28DAF00020D
Chmask: 4000

Zones (1)

Name	Light count	Avg. Daily kWh	Room	
Zone 0001	33	86	Default Room	Coord Edit

[New Zone](#)

Lights (33)

AB-1 (001136FE)	AM-4 (00110AE5)	Pharm C (0, 0) (03FFC026)	Pharm C (1, 4) (03FFC032)
AB-2 (001103DC)	AM-5 (0011039F)	Pharm C (0, 1) (03FFC028)	Pharm C (2, 0) (03FFC027)
AB-3 (001110FC)	AM-6 (001103C1)	Pharm C (0, 2) (03FFC02B)	Pharm C (2, 1) (03FFC02A)
AB-4 (0011135A)	AT-1 (00110046)	Pharm C (0, 3) (03FFC02E)	Pharm C (2, 2) (03FFC02D)
AB-5 (001138BD)	AT-2 (00110009)	Pharm C (0, 4) (03FFC031)	Pharm C (2, 3) (03FFC030)
AB-6 (00110004)	AT-3 (00110144)	Pharm C (1, 0) (03FFC025)	Pharm C (2, 4) (03FFC033)
AM-1 (0011058E)	AT-4 (0011018F)	Pharm C (1, 1) (03FFC029)	
AM-2 (00110615)	AT-5 (001108CC)	Pharm C (1, 2) (03FFC02C)	
AM-3 (00110D93)	AT-6 (00110148)	Pharm C (1, 3) (03FFC02F)	


[Discover Lights](#) [Verify Lights](#)

[Edit](#) | [All Networks](#)

To perform configuration tasks, click the Configuration tab and then select the desired option from the dropdown menu.

- In configuration mode, you can view each light's assigned zone, room, and network, and respond to your facility's changing needs over time by editing those assignments.
- More frequently, you can create and edit profiles. Profiles control some or all zones and the settings assigned to those zones. To activate a profile, schedule that profile with the calendar or use the manual control feature.
- Additionally, during or following LightRules System configuration, you may optionally configure power devices, create groups of power devices for reporting purposes, and edit power device groups as the facility's monitoring needs change over time.

Calendar

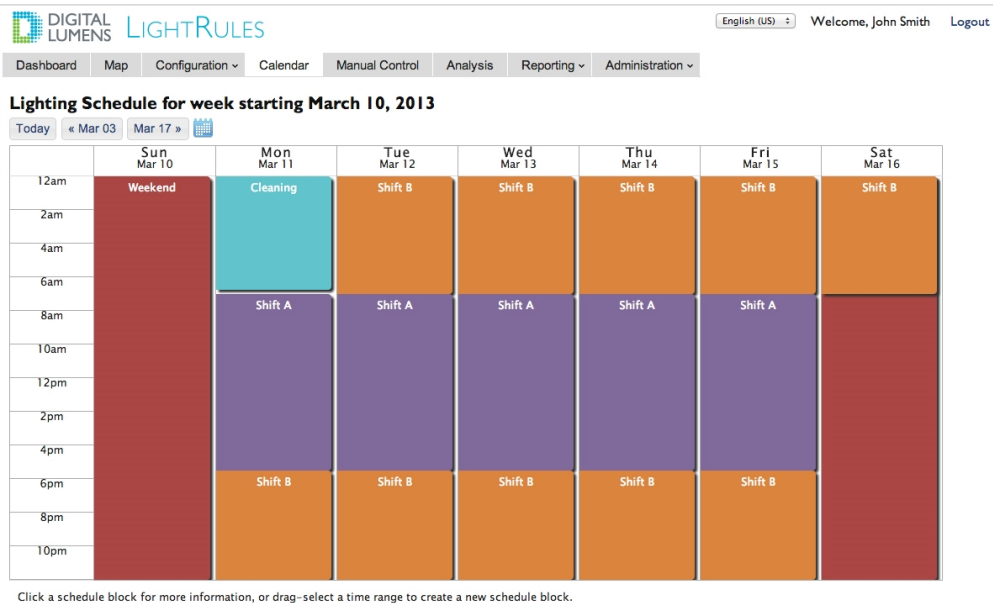

The calendar offers a quick and easy way to set up an automated lighting schedule. Reserve a block of time on the calendar by scheduling a lighting profile for a single event, or schedule a profile that triggers on a recurring basis according to the selected parameters.



Note: Before you use the calendar, you must first set up one or more [lighting profiles](#).

- A profile is a list of rules for some or all configured zones.
- A zone corresponds to an area of your facility. For example, one zone may cover a single aisle, a group of aisles, or a loading dock.
- A rule defines the active power level, the inactive power level, and the sensor delay for all lights in a zone.

Manual Control



English (US)Welcome, John Smith

DashboardMapConfigurationCalendarManual ControlAnalysisReportingAdministration

Manual Control

Profile

Default Profile

EditCloneCreate NewReset

Expiration

Fixed Duration

Expiration

60

Save and Push

Name

Default Profile

Select zones for override


Zone	Gang	Inactive	Active	Delay (sec)
Farm C	☐	0	100	30
Zone 0001	☐	0	100	30

Add RuleSave

You can set the calendar to automatically trigger profiles based on a schedule. However, you can use the manual control feature to override the lighting schedule and dynamically change the settings for some (or all) of the lights in your facility. Manual control lasts for a fixed duration or indefinitely, until you cancel it.

If the facility is using the optional LightRules Keypads, note that keypads use manual control. For example, when you press button #3 on a keypad, the button press triggers an assigned manual profile. Manual control can be canceled via the LightRules dashboard.


Comparative Analysis

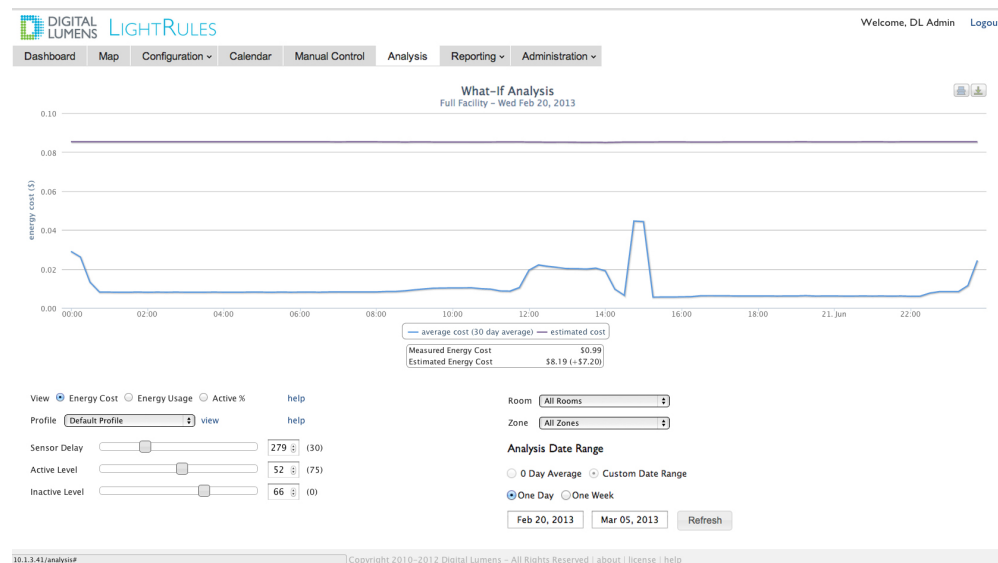

LightRules software features what-if analysis, which estimates the energy savings one would realize if using different settings across a zone, a room or the entire facility. What-if analysis utilizes real, historical data to make what-if predictions.

Likewise, the baseline function uses historical data to compare savings from your Digital Lumens Intelligent Lighting System versus the previously installed lighting system or an LED system (without intelligent control) with its lights ALL ON.

Reporting

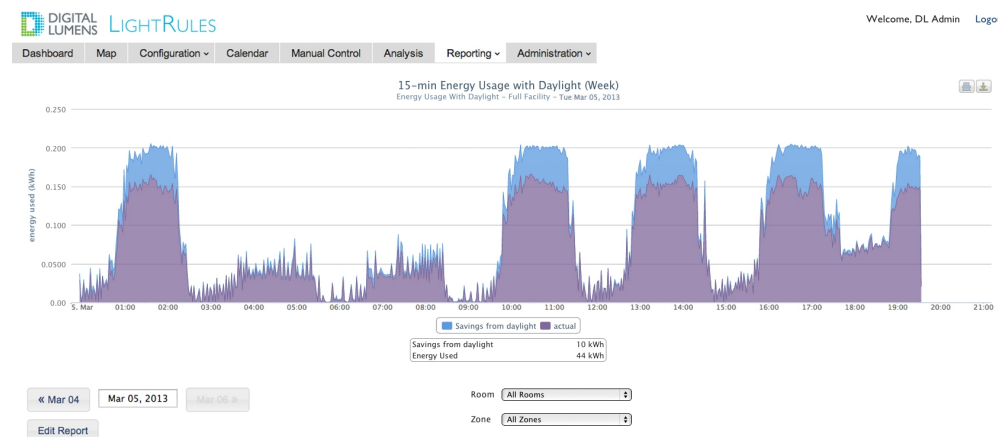

LightRules features preconfigured, default report templates to help you start analyzing data right away. The built-in templates are designed to cover the most common occupancy data, energy usage and energy cost requests.

- You can also create custom reports where you specify the time interval between data points, duration, and chart appearance. You can also create reports containing data collected power meters.
- Facility map reports display data as an overlay on the facility floor plan.
- Reportable data in LightRules is available for print and export to raw CSV file, image file, or PDF document.

Administration

Use the Administration screens to perform standard user setup operations, general site configuration, configure safety features, toggle coordinated control, daylight harvesting, or power metering On/Off and perform data backup tasks.



Note: LightRules offers three levels of "User Permissions" (see page 15), each allowing access to part of the LightRules interface. For example, users set up with **Operations** and **Admin** permissions have access to the entire LightRules web interface, whereas users set up with **Reporting** permissions receive access only to reporting-related features.

Hardware Components


The LightRules system is made up of the following:




The LightRules Appliance is the central controller for the LightRules Intelligent Lighting System. It stores lighting and sensor data and manages the lighting gateways and control of fixtures throughout the premises.




Ethernet cables and network switches connect the appliance to the gateways. Typically, the switches are PoE (Power over Ethernet)-enabled devices that supply electrical power to the gateways, eliminating the need to install 120-240 VAC power sources at each gateway location.




Gateways create a network bridge between the Ethernet components in the lighting network and the lights. Each gateway manages communications for up to 50 lights within an unobstructed wireless range.



LightRules keypads are wall-mounted controllers with eight configurable buttons. When a user presses button 1-8, the keypad triggers the assigned manual profile. Typically one keypad per room in the facility is sufficient.




Power meters collect precise energy measurements from any electrical equipment in a facility. LightRules 2.software accepts data from specific models of third-party power meters supplied by Digital Lumens.



Power gateways are required to facilitate two-way communication between the power meters and LightRules. LightRules is compatible with specific models of third-party power gateways supplied by Digital Lumens.

Example System Diagram

LightRules runs on a secure, dedicated network within the facility.

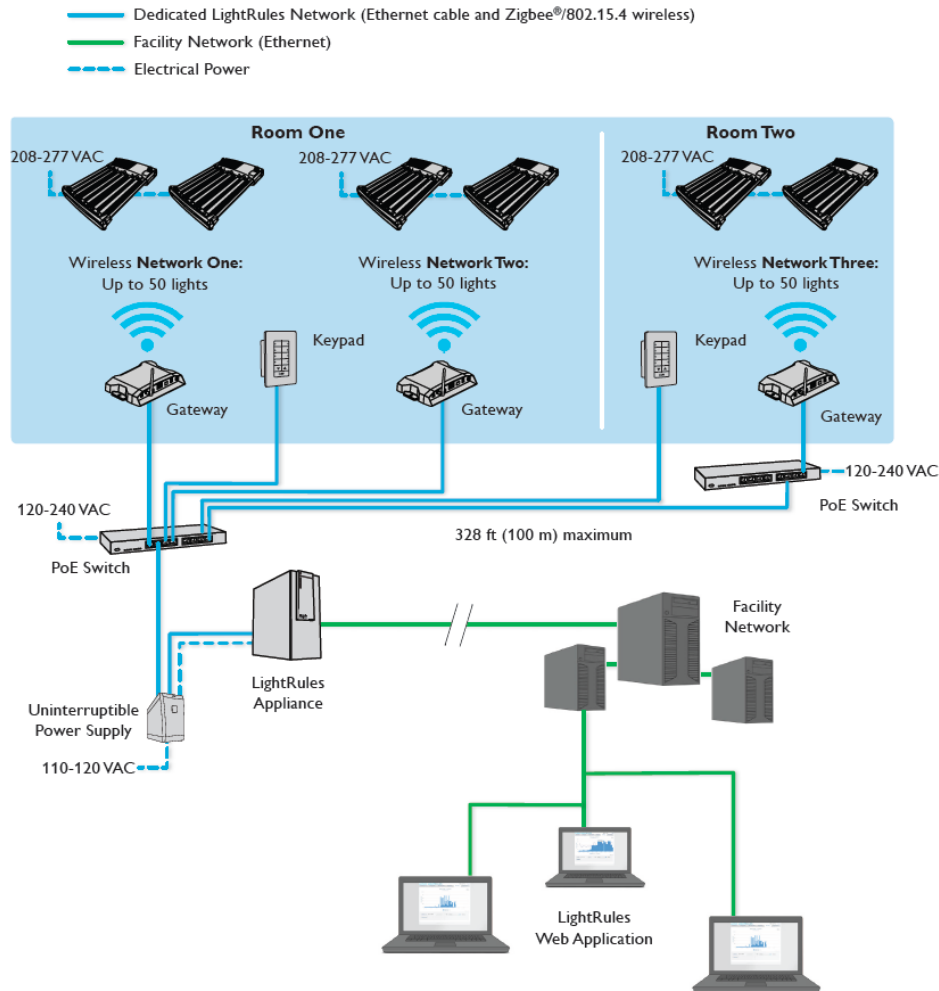

Add a Monitor, Keyboard, or Mouse

LightRules is a web-based application accessible via any web browser on the facility's enterprise network. The system can also be set up in a stand-alone configuration with a keyboard, monitor, or mouse.

1. Press and release the power button.
The LightRules appliance will power down in about 15-20 seconds. If the system has not powered down after one minute, press and hold the power button until the appliance turns off.
2. Connect the keyboard, monitor, or mouse.
3. Press the power button to reboot the appliance.

User Permissions

There are four types of user permissions— a user may have one or all four types. Each permission grants access to a portion of the user interface, as follows:

Reporting Permission	Operations Permission
• All report actions • What-if Analysis	• Push profiles via manual control • Cancel manual control • Ping a light or gateway • View and modify the calendar • View networks, rooms, zones, and lights • View and edit profiles • Add, edit, and delete Control Stations
Administration Permission	Station Operator Permission
• All user setup functions • Network, room, zone, and light configuration • Data backup • Site configuration • Discover operation • Upload/Download map files • View and modify the calendar • View networks, rooms, zones, and lights • Start, extend, and cancel Control Station overrides	• Start override • Extend override • Cancel override

Commissioner Software

Commissioner software is the toolset used to create map files and calibrate daylight harvestnig lights during system installation.

To ensure optimal Intelligent Lighting System startup and commissioning, Digital Lumens Application Engineers provide onsite support, management, and technical service. Using Commissioner software helps ensure proper equipment installation and connectivity. The LightRules server is then integrated onto the facility's enterprise network. Finally, lighting profiles and schedules are established to match the facility's needs and energy goals.

For more information, please see [Commissioner documentation](#).

Contact Digital Lumens Technical Support

- If you need installation or advanced troubleshooting information, please contact technical support via email at support@digitallumens.com.
- In case of emergency, or if you need immediate assistance, please contact Digital Lumens technical support by phone at **+1 (617) 723-1200, extension 3**.
- If you are a partner, to open a support ticket, go to digitallumens.zendesk.com. Once you've created an account, you'll have full access to partner content and technical support features.

Chapter Two:

Quickstart Guide


LightRules Quickstart Guide

This guide tells you how to quickly get started with LightRules. The following information is discussed in general here:

Logging in

New Account Registration

When the system admin sets up your account, LightRules automatically generates and sends you an email with confirmation instructions:

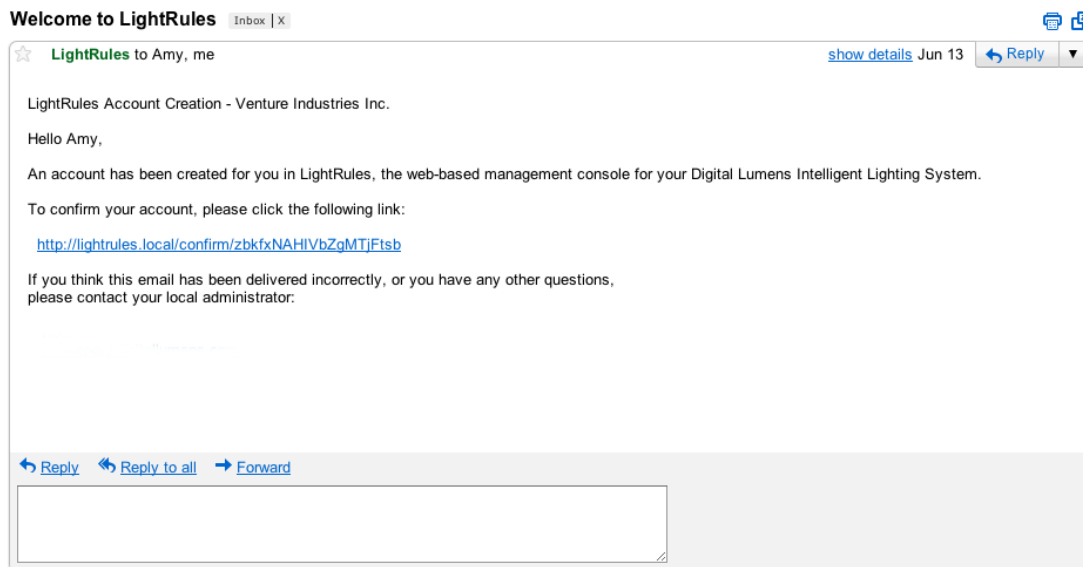

1. Click the link in the email.
2. Enter the desired password in the top field. Your password must contain at least four characters or digits.
3. Enter your password a second time in the bottom field.
4. Click **Change Password**.
5. Read the End-User License Agreement (EULA) and then click **I Agree**.



Note: If your network configuration is stand-alone (the LightRules appliance is not connected to the facility's enterprise network), the system admin will create your password during account creation.

Account Login



Login

Please log in

Email*

Password*

[Reset forgotten password](#)

1. Open the Login screen by clicking the link in the new account email you received from LightRules.
2. For future use, create a bookmark to the link in your web browser.
3. Enter your email address and password.
4. Click **Log In**.

i **Tip:** During installation, if a default email domain has been configured, then LightRules accepts the first part of a user's email address as a valid login. For example, if the email address is "amy.jones@ventureindustries.com" that user can log in using either of the following: **amy.jones@ventureindustries.com** or **amy.jones**

Resetting Your Password

1. At the Login screen, click **Reset forgotten password**.
2. At the Reset Password screen, type your email address, and then click **Reset Password**.
3. Open the auto-generated email from LightRules and click the link.
4. Enter your new password in the top field.
5. Enter the password a second time in the bottom field.
6. Click **Change Password**.



Facility Map

Click the **Map** tab to open the facility map, which displays lighting system information as an overlay on the facility floor plan. There are two map views: **Rooms** view and **Statusview**.

Rooms View

Rooms view shows all light, zone, and room details at a glance. Each light appears as a square on the map. You can ping lights and access light settings via each light's quick-view popup.

Facility Map

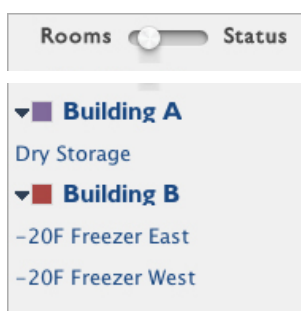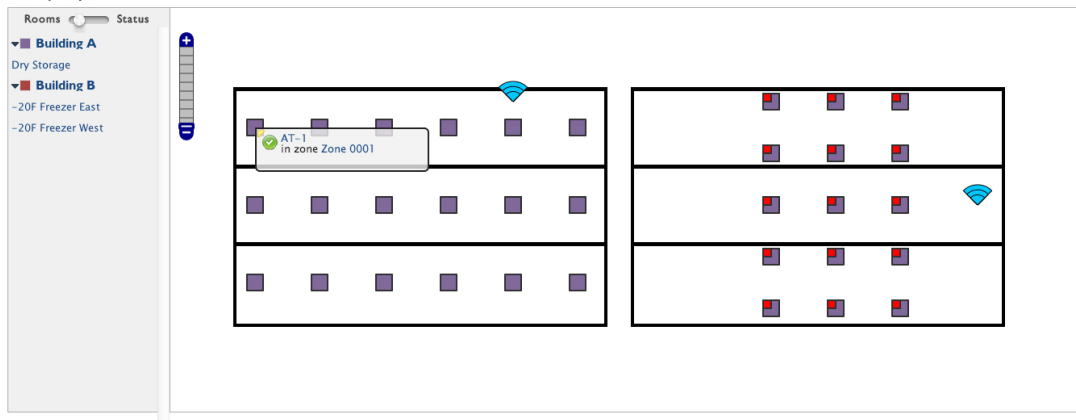

Use the *toggle button* to switch between rooms view and status view.

The *legend* lists each room and zone in the facility. Rooms are color-coded: All lights in the same room appear have the same color on the map. Click a room to expand the zone list for that room. Click a zone to highlight all lights in that zone.



In rooms view, all lights display as square icons.



If a light is calibrated and enabled for daylight harvesting, the icon contains a yellow box.



If a light is configured as a coordination master, the icon contains a red box.



All gateways appear as wedge icons.




All keypads appear as boxed circle icons.




Power meters appear as meter dial icons.



Power gateways appear as rectangular icons.



When you click on a light or gateway icon, that device's quick-view popup appears. The popup shows the name and zone assignment. The status icon indicates if the device is actively communicating with LightRules (green icon), if the device has not communicated with LightRules in 24 hours (yellow icon), or if the device is out of sync or has never communicated with LightRules (gray icon). Click on the status icon to ping the device and update its status in the map. Additionally, if you click on the name, the configuration page for that device appears. Note that the yellow tab in the upper-left or upper-right corner of the popup points to the device whose information is being displayed.




Click anywhere on the *zoom control* to zoom in or out.



In the lower-right corner of the map, click-and-drag the *re-size control* to re-size the map window.

Status View

Status view shows the status of each light: a green circle indicates that the light is actively communicating with LightRules, a yellow circle indicates that the light has not communicated with LightRules in 24 hours, and a gray circle indicates that the light is out of sync or has never communicated with LightRules.

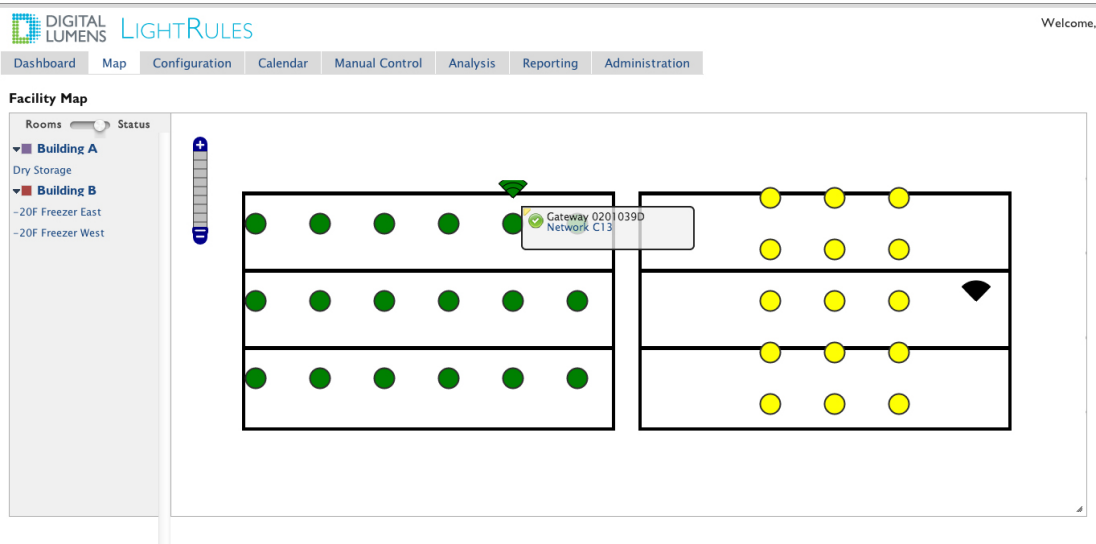

-  In status view, communicating lights and gateways appear as green icons.
-  In status view, non-communicating lights and gateways appear as yellow icons.
-  If a light is out of sync, or if a light has never communicated with LightRules, it appears as a gray icon.

Viewing Detailed Light Information

From either the rooms view or status view, click on a light to open the quick-view popup, and then click on the light name to view that light's information screen.



[Dashboard](#)
[Map](#)
[Configuration ▾](#)
[Calendar](#)
[Manual Control](#)
[Analysis](#)
[Reporting ▾](#)
[Administration ▾](#)

Light ILE A2-2

Serial Number: 03FFC01A
 Product: 21300-03 (ILE-3-13, Narrow optic)
 Install Date (approx): 2012-12-07
 Zone: [Farm A](#)
 Network: [F03](#)
 Status: green
 Last Scanned: 06 Mar 10:56am

Usage Polling: enabled
 Light Sensor Ready: no
 Daylight Harvesting: disabled
 Coordination: listener

Description:

Programmed on Tue Aug 21 2012 at 09:19:02

[Raw Usage](#) | [Edit](#) | [All Lights](#)
select a day range to download raw usage data

through (inclusive)

About Raw Usage Data

LightRules software features expanded data access on a per-light basis. The raw data file includes the following:

- Total time since the light was last reset.
- Total time the light has been in active mode.
- Total energy usage.

Download Raw Usage Data as CSV File Format


1. Click **Raw Usage**.
2. Enter a date range and then click **download**.
3. Open the CSV file using a simple text editor or spreadsheet software.

Using Manual Control

Manual control enables you to override the current lighting schedule via the LightRules dashboard or via buttons 1-8 on a LightRules Keypad (if installed). This feature is useful for testing new settings, for handling unscheduled events, and for emergency lighting.


Activating an Existing Manual Profile

1. On the dashboard, click **Manual Control** or click the **Manual Control** tab,
- or -
press a button (1-8) on a keypad (in the facility, if installed).
2. Select a profile.
3. Select an expiration setting before pushing a manual profile:

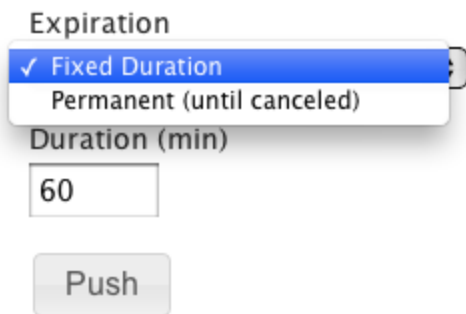

The image shows a dropdown menu for selecting an expiration setting. The menu is titled "Expiration" and has two options: "Fixed Duration" (which is selected and highlighted in blue) and "Permanent (until canceled)". Below the dropdown is a text input field labeled "Duration (min)" containing the value "60". At the bottom of the form is a "Push" button.

- **Fixed Duration** runs the manual profile for a set period of time, in minutes.
 - **Permanent** runs the manual profile indefinitely, until you cancel that profile.
4. Click **Push** to activate the manual profile by broadcasting the settings over the lighting network to the lights.
When you push (or cancel) a manual profile, LightRules displays a progress bar on the dashboard.
 5. At any time, to end a manual profile, click the "X" within the Active Profiles widget on the dashboard, and then click **OK** to confirm.

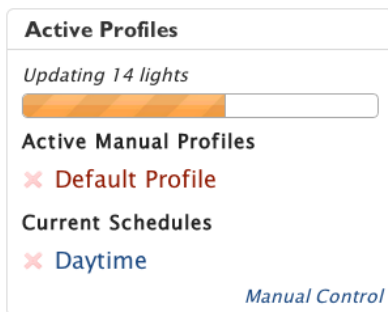

The image shows the "Active Profiles" widget on the dashboard. It has a title bar "Active Profiles" and a progress bar labeled "Updating 14 lights". Below the progress bar is a section titled "Active Manual Profiles" with a red "X" icon and the text "Default Profile". Below that is a section titled "Current Schedules" with a red "X" icon and the text "Daytime". At the bottom right of the widget is the text "Manual Control".

Active Profiles Widget

The dashboard displays the lighting schedule as a list within the active profiles widget.

- When you activate a manual profile, that manual profile overrides all current schedules and appears at the top of the list.
- When you cancel a manual profile, LightRules reverts to the next profile in the list.

Because a manual profile may only affect a portion of the facility, you may activate multiple manual profiles at the same time. However, only one button per keypad can be active at one time.

Using Automatic Control

When you schedule a lighting profile, that profile runs automatically according to the start and end times you specify in the LightRules calendar.

Using the Calendar to Schedule an Existing Profile

1. Click the **Calendar** tab.
2. As needed, navigate ahead in the calendar.
3. Click and drag on the calendar to create a new block.
4. Type a name for the block and then select a profile from the dropdown list.

The screenshot shows the LightRules web interface. At the top, there's a navigation bar with tabs: Dashboard, Map, Configuration, Calendar (selected), Manual Control, Analysis, Reporting, and Administration. The main area displays a 'Lighting Schedule for week starting March 10, 2013'. The calendar shows days from Sunday, March 10 to Saturday, March 16. Time slots are listed on the left from 12am to 10pm. Various colored blocks represent different lighting profiles: 'Weekend' (blue), 'Cleaning' (orange), 'Shift A' (red), 'Shift B' (purple), and 'New Block' (green). A 'Create a New Schedule Block' dialog is open, showing fields for Name, Description, Profile (set to 'all on zone 1'), and Repeat Options (set to 'Mar 12 only'). The dialog also includes checkboxes for 'All Day' and 'Overnight?' and a time range from 05:45 AM to 07:00 AM. At the bottom of the dialog are 'Cancel' and 'Save' buttons.

5. Enter start and end times.

6. (Optional) Select from the Repeat Options:
 - **[date] Only**: Triggers the profile at the specified start time and cancels the profile according to the end time. This option runs the profile once.
 - **Every [day of the week]**: Triggers the profile on a recurring basis. Specify an end date, as desired.
 - **[day of the week] of every month**: Triggers the profile on a day of the month, every month.
 - **Repeating Weekdays**: Triggers the profile on a recurring basis, on the checked days of the week. Specify an end date, as desired.
7. Click **Save**.

i **Tip:** LightRules permits you to create profiles that don't include all zones. Therefore, you can schedule a profile for a section of the facility. The partial schedule can stack on top of a schedule that covers the entire facility. The most-recently scheduled profile takes priority. If no profile is scheduled, LightRules runs the default profile, which is configured during system installation. The white background of the calendar represents the default profile. Therefore, if you don't add blocks to the calendar, you are always running the default profile.

If the LightRules network is not operational due to an equipment or network issue, each light will automatically continue to run its last received profile.

Using the Calendar to Edit a Scheduled Profile

1. Click the **Calendar** tab.
2. Navigate to the block you wish to modify and then click on that block.
3. Click **Edit**.
4. Enter new parameters then click **Save**.

Creating a Zone

A zone contains a portion of the lights in the facility and corresponds to a physical area. You can create a new zone from scratch or by splitting an existing zone. When you create a zone from scratch, you need to add lights — otherwise that zone will be empty.

New Zone

Name

Network

G14

Room

Unassigned Room

☐ Ignore Occupancy Sensors

Lights in this zone will ignore occupancy sensors. Useful in unusual mounting conditions.

☐ Safety Lighting

Lights in this zone should never be set below the configured Safety Lighting Minimum Level (currently 20).

☐ Coordination Enabled

Lights in this zone will coordinate and synchronize their active state.

Description

Default Rule

Active power

100

Inactive power

0

Delay (sec)

30

Create Zone

All Zones

1. Click the **Configuration** tab and select **Zones** from the dropdown list.
2. Click **New Zone**.
3. Type a name for the zone.
4. Select a **Network ID** from the dropdown list (use the same Network ID as used by the gateway in that zone).
5. Select the room in which the zone resides from the dropdown list.
6. (Optional) Check **Ignore Occupancy Sensors** only if the facility has opted not to use occupancy sensing.
For example, some aircraft hangers do not use occupancy sensing.
7. (Optional) Check **Safety Lighting** to activate minimum active power/inactive power levels for this zone.
8. (Optional) Check **Coordination Enabled** to permit coordinated control for this zone.
9. (Optional) Enter descriptive text.
10. Enter the active and inactive power levels.
11. Enter the desired sensor delay.
12. Click **Create Zone**.

13. Click the **Configuration** tab and select **Lights** from the dropdown list.
14. For each light you wish to add to the new zone, click **Edit**, select the newly created zone name from the dropdown list, and then click **Update Light**.
15. "Perform a Sync" (see page 73).

Creating a Profile

A profile is a list of rules for some or all configured zones. To take effect, the profile must be pushed manually or scheduled as a block in the calendar.

LIGHTRULES

Dashboard
Map
Configuration
Calendar
Manual Control
Analysis
Reporting
Administration

New Profile

Name

Description

This short summary will be displayed in the Calendar and Dashboard.

Zone	Gang	Inactive	Active	Delay (sec)
Rack A		0	90	90
Rack B		0	100	120
Rack C		10	83	120

Add Rule

Save

[All Profiles](#)

1. Click the **Configuration** tab and select **Profiles** from the dropdown list.
2. Click **New Profile**.
3. Type a name for the profile.
4. Select a zone from the dropdown list.
5. As desired, modify the default rule for the selected zone:
 - Use the right slider to adjust the active power level (20 - 100).
 - Use the left slider to adjust the inactive power level (0 - 100).

- Enter the desired sensor delay (minimum 30 seconds).
6. Click **Add Rule** and then repeat step 5 for each desired zone.
 7. Click **Save**.

Rule Definitions

- **Active Power Level:** The amount of illumination delivered by a light when there is activity detected below that light.
- **Inactive Power Level:** The amount of illumination delivered by a light then there is no activity detected below that light.
- **Sensor Delay:** The length of time in which no activity is detected before a light switches from active power mode to inactive power mode.


 **Tip:** To rapidly change power level rules in unison across multiple zones, click the gang toggle switch for those zones and then move the left and/or right slider in one of the selected zones.

Performing a Sync

When you update a room, zone, or light, you have changed the map file and LightRules requires a sync operation to push the new settings over the lighting network to the lights in the facility. LightRules displays a prompt when one or more pending map file changes require syncing; you can sync more than one change at a time.

Syncing the Map File

1. On the dashboard, in the *Map Changes Pending* prompt, click **Sync or Revert**



Map Changes Pending
Sync or Revert pending map changes.

2. Review the description of the pending map file changes.
3. Click **Sync** to push the new settings to the lights,
- or -
click **Revert** to cancel all changes.
4. Click **OK**.

Basic Diagnostics

LightRules continually checks the lighting network for connectivity and/or changes to the map file that have not been received by the lights or other devices. If there is an issue, LightRules identifies the affected portion of the network and displays an alert icon:



The network or device is communicating normally.



LightRules has not communicated with the network or device in the last 24 hours.



LightRules is out of sync or has never communicated with the network or device.

Chapter Three:

Manual Control

Manual Control



User Considerations: The manual control feature requires **Operations** "User Permissions" (see page 15).

Overview

With the manual control feature, LightRules enables you to override part or all of the currently running scheduled profile and implement one or more temporary profiles for a specified period of time, or indefinitely until canceled.

- Manual profiles can be set to change the light settings of a single zone, a set of zones, or the all zones in the facility.
- The dashboard displays the manual profile(s) in use and allows you to cancel each manual profile separately, at any time.

A manual profile does not automatically override all other running profiles. To completely override all profiles (and therefore all lights) the manual profile must contain all zones in the facility.

Manual Control Tasks

Perform the following tasks with LightRules manual control:

Push an Existing Manual Profile

When you push a manual profile over the lighting network to the lights, the profile requires several seconds or minutes to become fully active, depending on how many lights are affected. The progress bar displays the percentage of the operation that is complete.

1. Out in the facility, press button 1-8 on a keypad,
- or -
click the **Manual Control** tab or click **Manual Control** in the Active Profiles widget on the dashboard.
2. Select an existing profile from the dropdown menu.
3. Select an "Expiration Settings" (see page 35) from the dropdown menu and then click **Push** to activate the manual profile.

Active Profiles

Current Schedules

Daytime

Manual Control

Create a new Manual Profile

Manual profiles are helpful for testing new settings. For example, to test a new occupancy sensor

setting, you can push a manual profile, walk out into the facility and check the new settings, and then cancel the manual profile. Manual profiles are also useful for handling one-time or non-scheduled events, including facility maintenance and demand-response events. Additionally, the optional LightRules Keypad activates a manual profile when a user presses button 1-8.


Tip: Create and save manual profiles for future use so you can instantly access and push a profile on-demand, when it is needed.

1. Click the **Manual Control** tab.
2. Click **Create New**.
3. Using a logical naming convention, type a new name for the manual profile.
4. Click **Add Rule** to add one or more zones.


Note: When you create a manual profile, you do not have to include all zones. For example, a manual profile can contain a single zone that you wish to control manually while the rest of the facility continues running the scheduled profile.

5. Edit the zone rules, as desired.



[Dashboard](#)
[Map](#)
[Configuration](#)
[Calendar](#)
[Manual Control](#)
[Analysis](#)
[Reporting](#)
[Administration](#)

New Profile

Name

Description

This short summary will be displayed in the Calendar and Dashboard.

Zone	Gang	Inactive	Active	Delay (sec)
Rack A		0 <input type="range"/>	90	90
Rack B		0 <input type="range"/>	100	120
Rack C		10 <input type="range"/>	83	120

[All Profiles](#)

6. Click **Save** to save the manual profile for future use, without activating it, - or -

select an "Expiration Settings" (see page 35) from the dropdown menu and then click **Save and Push** to save and instantly activate the manual profile.



Note: The push operation takes from a few seconds to several minutes to complete. Most lights update instantly. When you push a manual profile, LightRules displays the progress bar

on the dashboard:

Updating 14 lights



Active Profiles Display

The dashboard displays the current lighting schedule and any running manual profiles. If you activate a manual profile, that manual profile overrides all other profiles, manual and scheduled. On the dashboard, the new manual profile appears above all other profiles.

When you cancel the manual profile, LightRules reverts to the next profile shown in the list.

Active Profiles

Active Manual Profiles

✕ Nighttime Profile

Current Schedules

✕ Daytime

Manual Control

Clone a Manual Profile

1. Click the **Manual Control** tab.
2. Select any existing profile from the dropdown list and then click **Clone**.
3. Using a logical naming convention, type a new name for the manual profile.
4. Click **Add Rule** to add zones, as needed; or, click the "X" next to a zone to delete that zone.
5. Edit the zone rules, as needed.
6. Click **Save** to save the manual profile for future use without activating it,
- or -
select an "Expiration Settings" (see page 35) from the dropdown menu and then click **Save and Push** to save and instantly activate the manual profile.

Edit a Manual Profile

1. Click the **Manual Control** tab.
2. Select any existing manual profile manual from the dropdown list and then click **Edit**.
3. Click **Add Rule** to add zones, as desired; or, click the "X" next to a zone to delete that zone.
4. Edit the zone rules, as desired.


5. Click **Save** to save the manual profile for future use without activating it,
- or -
select an "Expiration Settings" (see page 35) from the dropdown menu and then click **Save and Push** to save and instantly activate the manual profile.

Cancel a Manual Profile

The active manual profile de-activates when you click the "X" next to that manual profile in the Active Profiles widget on the dashboard. If you are running multiple manual profiles, you may cancel each manual profile individually.

Expiration Settings

Select an expiration setting before pushing a manual profile:

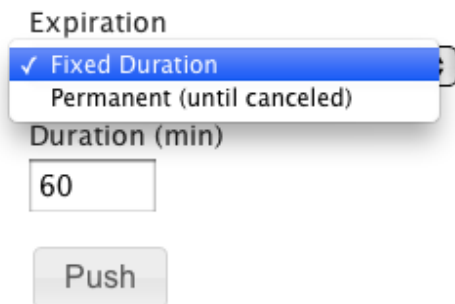

The form contains a dropdown menu labeled "Expiration" with two options: "Fixed Duration" (selected with a checkmark) and "Permanent (until canceled)". Below the dropdown is a text input field labeled "Duration (min)" containing the value "60". At the bottom of the form is a "Push" button.

- **Fixed Duration** runs the manual profile for a set period of time, in minutes.
- **Permanent** runs the manual profile indefinitely, until you cancel that profile.

Chapter Four:

Calendar Control

Calendar Control



User Considerations: The calendar feature requires **Operations or Administration "User Permissions"** (see page 15).

LightRules automatically controls the lighting levels in your facility based on a lighting schedule. The default lighting profile configured during system installation populates the calendar.

- When you click and drag a time range on the calendar, LightRules schedules a profile, which is represented by a solid-colored block.
- You can create a block for a single calendar date or specify repeat options so that the block recurs on a specific day of the week, a day of the month, and so on.
- If you stack one profile block on top of another, the most recently created block has priority.



Tip: The white background on the calendar represents your default lighting profile. When you add a block to the calendar, you are effectively overriding the default profile by scheduling a profile for a period of time. The default profile resumes when the block expires.

Calendar Control Tasks

General Strategy for Creating a Lighting Schedule

Use the following guidelines when creating your facility's lighting schedule:

- Maximize lighting levels for safety and comfort while the facility is occupied during a typical workday.
- Identify time periods where the facility, or areas of the facility, are unoccupied and schedule accordingly.
- If any areas of the facility require elevated lighting levels on a regular basis, schedule accordingly.

A typical facility will block the following profiles on the calendar:

1. Day Schedule: M-F, 6am to 7pm, full occupancy profile.
2. Night Schedule: Nightly, 7pm to 6am, reduced occupancy profile.
3. Weekend Schedule: Sat + Sun, 6am to 7pm, reduced occupancy profile.

Reviewing the Calendar

Click the **Calendar** tab to open and review the calendar. Each block represents a scheduled profile.

Click a block to review its settings and then click **Cancel** to exit.

Lighting Schedule for week starting July 22, 2012

Today « Jul 15 Jul 29 » 

	Sun Jul 22	Mon Jul 23	Tue Jul 24	Wed Jul 25	Thu Jul 26	Fri Jul 27	Sat Jul 28
12am		Nighttime	Nighttime	Nighttime	Nighttime	Nighttime	Nighttime
2am							
4am							
6am							
8am	Daytime	Daytime	Daytime	Daytime	Daytime	Daytime	Daytime
10am							
noon							
2pm							
4pm							
6pm							
8pm	Nighttime	Nighttime	Nighttime	Nighttime	Nighttime	Nighttime	Nighttime
10pm							


Click a schedule block for more information, or drag-select a time range to create a new schedule block.

The calendar provides standard navigation controls for scrolling to the next/previous week. You can also click on the mini calendar icon and jump to a specific day, month, and year.

Today « Jun 19 Jul 03 » 

i **Tip:** By default, the calendar starts each week on Sunday. You can configure a different day as the start of the week, as needed. Go to "Editing Date and Time Settings" (see page 83) for more information.

Using the Calendar to Schedule a Block

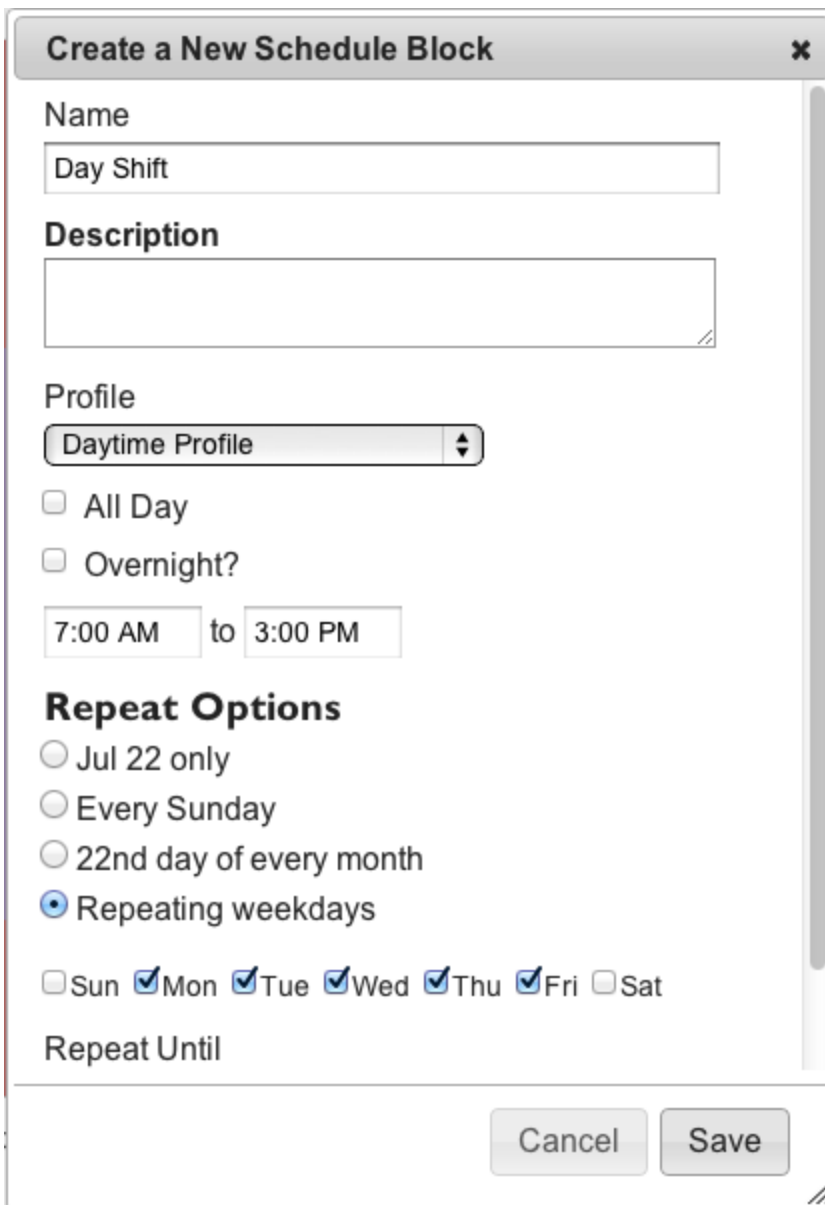

The screenshot shows a dialog box titled "Create a New Schedule Block" with a close button (X) in the top right corner. The dialog contains the following fields and options:

- Name:** A text input field containing "Day Shift".
- Description:** A large text area for additional details.
- Profile:** A dropdown menu currently showing "Daytime Profile".
- Time Range:** Two input fields showing "7:00 AM" and "3:00 PM" separated by a "to" label.
- Repeat Options:** A group of radio buttons with the following options:
 - ☐ Jul 22 only
 - ☐ Every Sunday
 - ☐ 22nd day of every month
 - ☒ Repeating weekdays
- Days of the Week:** A row of checkboxes for each day of the week: Sun, Mon, Tue, Wed, Thu, Fri, Sat. The checkboxes for Mon, Tue, Wed, Thu, and Fri are checked.
- Repeat Until:** A label for a date field, which is currently empty.

At the bottom right of the dialog are two buttons: "Cancel" and "Save".

1. Click the **Calendar** tab.
2. As desired, scroll ahead to a different week in the calendar or jump to a specific day, month, and year.
3. Click and drag on the calendar to create a new block.
4. Type a name for the block and then select a profile from the dropdown list.

5. Specify start and end times.
6. Select from the Repeat Options:
 - **[date] Only** LightRules triggers the profile according to the start and end times.
 - **Every [day of the week]** Triggers the profile on a recurring basis. Specify an end date, as desired.
 - **Every [day of the month]** Triggers the profile on a recurring basis. Specify an end date, as desired.
 - **Repeating Weekdays** Triggers the profile on a recurring basis, on the checked days of the week.
Specify an end date, as desired.
7. Click **Save**.

 **Tip:** Use the Repeating Weekdays option and check all of the days of the week to repeat a profile every day.

Additional Options

When you schedule a profile, you may also check one of the following:

- **All Day** to create a block automatically starts at 12:00am and ends at 12:00pm, check the All Day box.
- **Overnight** to create a block that carries over into the next day, check the Overnight box.


If applicable, to specify an end date, enter a Repeat Until date.

 **Note:** It is preferable not to create blocks that span multiple days. Instead, use the repeat options described above to accomplish the desired result. For example, if you create a separate block for each weekday, you can then edit just that weekday rather than the span of days.

Using the Calendar to Edit a Block

1. Click the **Calendar** tab.
2. Navigate to and click on the block you wish to modify.


3. Click **edit**:

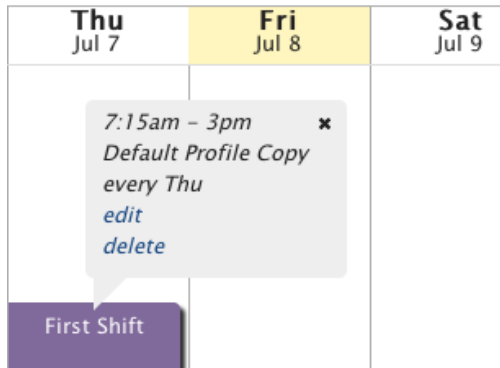

4. Enter new settings and then click **Save**.

Deleting a Block

1. Click the **Calendar** tab.
2. Navigate to and click on the block you wish to delete.
3. Click **delete**.
4. Select a delete option:

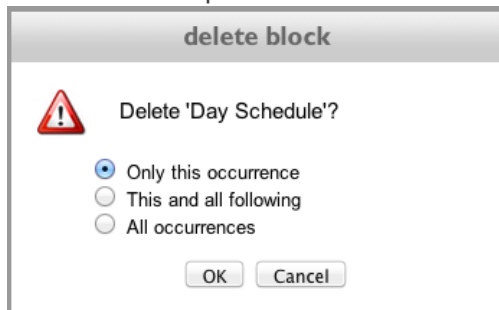

5. Click **OK**.

Chapter Five:

Reporting

Reporting

The LightRules reporting feature charts the facility's occupancy, energy usage, energy cost, and daylight harvesting-related data. You can choose among several chart styles, export data to CSV file, and export graph in image format. Additionally, the new facility map feature presents data as a visual overlay on top of the facility floor plan.



User Considerations: Running reports requires **Reporting** "User Permissions" (see page 15). Editing reports requires **Administrator** "User Permissions" (see page 15).

Standard Report Templates

LightRules installs with a set of preconfigured standard reports to help you start analyzing data right away. The built-in templates are shared among all users and designed to cover the most common requests.

Reporting Theory of Operation

This section describes how LightRules gathers data from lights and reports on that data:

- Lights record detail about when they are in active power level and inactive power level modes.
- Lights record detail about occupancy sensor events.
- LightRules polls all lights, retrieving detailed log information on a 15-minute cycle.
- Each time LightRules successfully communicates with a light, it remembers the "last seen" time.
- After each polling cycle, LightRules examines the detail from each light, counting the time the light was in the active and inactive modes. LightRules also uses the occupancy sensor events to count the time during which the area under each light was occupied.



Note: In some instances, a light may be configured with a dimming level above 0 for its inactive mode setting. For example, some lights – "night lights" – are configured this way for safety.

- From the recorded information, LightRules calculates the light's total Energy Usage (kWh) for each 15-minute interval. All reporting is based on either Energy Usage or Occupancy (time occupied as a percentage of total time).
- If the Average Energy Cost (dollars per kWh) is configured (see page 75 for details), LightRules can also display reports in Energy Cost by multiplying the Energy Usage (kWh) by Average Energy Cost (\$/kWh) to get an estimation of the Energy Cost for the given time.



Note: The Energy Cost calculation does not take into account variable energy cost or peak usage billing. It is meant as a convenience for LightRules users who are more comfortable viewing reports in monetary amounts than kilowatt-hour.

- Energy Usage and Occupancy values for each light per 15-minute interval are then aggregated into Zone/Interval, Room/Interval, and Total Facility/Interval values.
- Room/Interval and Facility/Interval values are aggregated into One Hour and One Day durations, resulting in Room/Hour, Room/Day, Facility/Hour, and Facility/Day values.

In LightRules software, the following aggregated values are exposed in the reporting system:

- Room/Interval
- Room/Hour
- Room/Day
- Zone/Interval
- Zone/Hour
- Zone/Day
- Facility/Interval
- Facility/Hour
- Facility/Day

Each light may be designated in one zone, and each zone may be designated in one room. Only the current light:zone zone:room mapping is used in aggregation, so aggregation includes only data captured since the last mapping change, whereas historical mappings are not aggregated.

Creating New Reports

You can also create reports from scratch. There are two report types:

- "Graph Reports" (see page 45)
- "Facility Map Reports" (see page 50)

Graph Reports

The following reporting parameters are fully editable for traditional graph reports:

Displayed Data Type	Data Point Interval	Report Duration	Chart Style
- Occupancy - Energy usage - Energy cost - Energy usage, with daylight harvesting data included - Average power (average power consumption in kilowatts rather than kilowatt hours)	15-minute interval - Hourly - Daily	- Daily - Weekly - Monthly - Custom (specify a custom duration, in days)	- Line - Area - Bar - Stacked (shows the usage or cost that each room contributes to the total)

Working with Graph Reports

Running Graph Reports

There are three ways to run reports:

- Select a report template from the **Favorites** dropdown list in the **Reports** dashboard widget
- Select a report template from the dropdown list under the **Reporting** tab
- Create or clone a report, and then click **Run in the Report Templates** screen

Tips for Viewing Reports


- Mouse-over a time interval in a chart to display data for that interval in a pop-up bubble.
- Click and drag on a horizontal area of a chart to zoom in on the data. Click Reset Zoom to cancel.
- Reports scale to the size of the browser window. If you want a wider graph so as to view a custom duration, stretch your browser window.
- Graph reports may display a main graph and one or more overlay graphs, based on the parameters specified in the report template. You can toggle the main graph and the overlay graph(s) On/Off by clicking their corresponding buttons (the text describing each graph is a clickable button).
- To enable energy cost reporting, you must enter an average dollar cost per kWh in the Administration General Settings. For example, enter \$.11/kWh to use \$.11 as the cost setting for all energy reports (see page 75 for details).
- All cost and usage graph reports - if the chart style is line or area - show baseline analysis data. The baseline analysis feature compares historical data from the Intelligent Lighting

System versus the energy usage of the previously installed lighting system, and versus an LED system with lights ALL ON.

- To enable baseline reporting, you must enter a value, in total watts, for the previously installed lighting system in the Administration General Settings. For example, enter 11,160 W if the previous system comprised 24 x 465 W lights (see page 75 for details).

Filter a Report By Room


1. Run a report.
2. In the Room panel of the report screen, select the room by which you want to filter results.

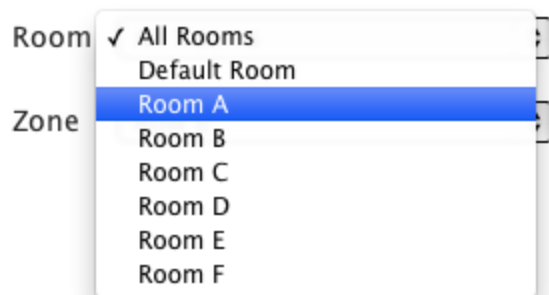

LightRules auto-refreshes the results.

Filter a Report By Zone

1. Run a report.
2. In the Zone panel of the report screen, select the zone by which you want to filter results.

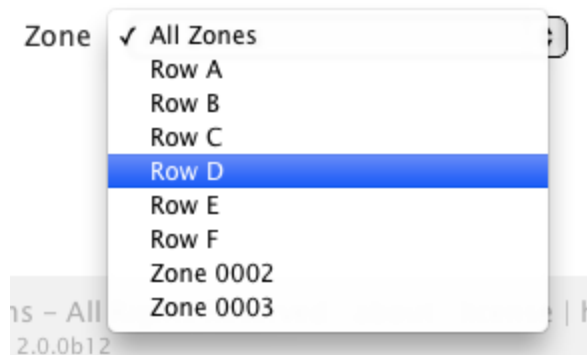

LightRules auto-refreshes the results.




Note: To clear the room or zone filter, select **All Rooms** or **All Zones**, accordingly.

Edit a Report Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **Edit** for the desired report:

Editing Report

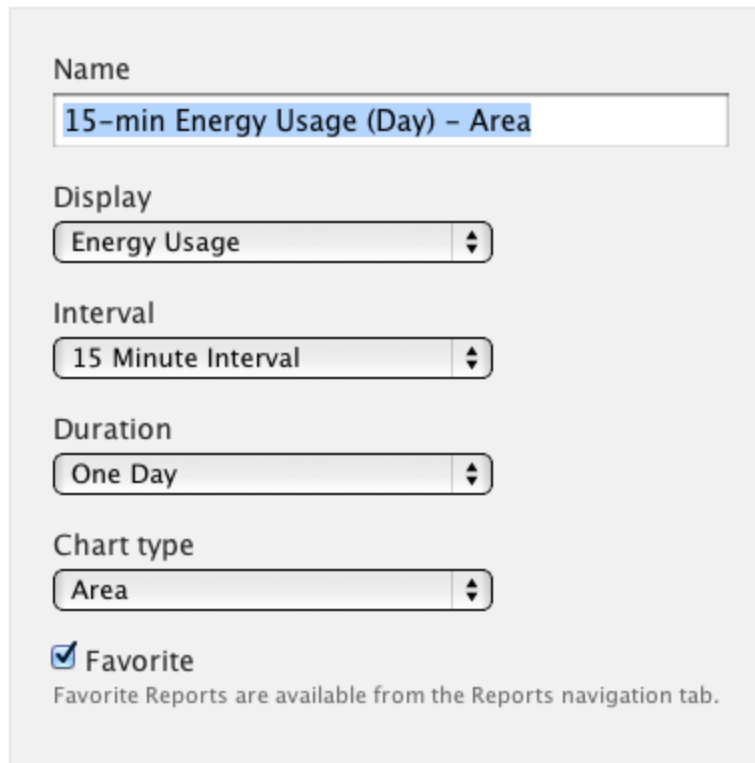

The screenshot shows a form titled "Editing Report" with the following fields:

- Name:** A text input field containing "15-min Energy Usage (Day) - Area".
- Display:** A dropdown menu with "Energy Usage" selected.
- Interval:** A dropdown menu with "15 Minute Interval" selected.
- Duration:** A dropdown menu with "One Day" selected.
- Chart type:** A dropdown menu with "Area" selected.
- Favorite:** A checked checkbox.

Below the checkbox, a note states: "Favorite Reports are available from the Reports navigation tab."

3. Modify one or more of the parameters.
4. (Optional) Check the Favorite box to add the report template to the favorites list on the dashboard.
5. Click **Update Report**.

Create a New Report Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **New Report**.
3. Select **Graph Report**.
4. Type a name for the report.
5. Modify one or more of the parameters.

6. (Optional) Check the Favorite box.
7. Click **Create Report**.

Clone an Existing Report Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **Clone** for the desired report template.
3. Click **Edit** for the newly created template.
4. Change the report name.
5. Modify one or more the parameters.
6. (Optional) Check the Favorite box to add the report template to the favorites list on the dashboard.
7. Click **Update Report**.

Delete a Report Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **Delete** for the desired report template.
3. Click **OK** to confirm deletion.

Add a Report Template to the Favorites List

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **Edit** for the desired report.
3. Check the Favorite box.
4. Click **Update Report**.

Run an Energy Cost Report

To run an energy cost report, you first have to enter a flat rate energy cost in the Administration feature:

1. Click the **Administration** tab and select **General Settings**.
2. Click **Edit General Settings**.
3. In the Energy Cost field, enter a flat rate amount (\$/kWh). For example type .11 for eleven cents/kWh.

4. Click **Save Settings**.
5. Click the **Reporting** tab and select an Energy Cost report template from the dropdown list.

Run an Energy Usage Report with Daylight Harvesting Data

- Click the **Reporting** tab and select an Energy Usage "With Daylight" report template from the dropdown list.

Graph reports with daylight harvesting data contain two chart lines:

- **Savings from Daylight:** The top line charts the difference between the amount of energy that would have been used without daylight harvesting implemented and the actual amount of energy used, in kWh.
- **Actual:** The bottom line charts the amount of energy used, in kWh.



Facility Map Reports

The following reporting parameters are fully editable for traditional graph reports:

Displayed Data Type	Favorites	Report Duration	Exporting Reports
- Occupancy - Energy usage - Energy cost - Energy usage, with daylight harvesting data included - Energy cost, with daylight harvesting data included - Average power (average power consumption in kilowatts rather than kilowatt hours)	On the dashboard, the My Reports widget contains a favorites list. You can customize the favorites list. To add a report to the list, check the Favorite box when creating a new report or editing an existing report.	30 days 60 days 90 days - Custom (specify a custom duration, in days)	- CSV raw data (export data to a format usable by spreadsheet software) - PDF document - JPEG image - PNG image - SVG vector image (print-quality image) To export a report, click the icon corresponding to the desired output type.

Working with Facility Map Reports

Running Facility Map Reports

There are three ways to run reports:

- Select a report template from the **Favorites** dropdown list in the **Reports** dashboard widget
- Select a report template from the dropdown list under the **Reporting** tab
- Create or clone a report, and then click **Run** in the **Report Templates** screen

Tips for Viewing Reports


- Mouse-over a time interval in a chart to display data for that interval in a pop-up bubble.
- Click and drag on a horizontal area of a chart to zoom in on the data. Click Reset Zoom to cancel.
- Reports scale to the size of the browser window. If you want a wider graph so as to view a custom duration, stretch your browser window.
- Graph reports may display a main graph and one or more overlay graphs, based on the parameters specified in the report template. You can toggle the main graph and the overlay graph(s) On/Off by clicking their corresponding buttons (the text describing each graph is a clickable button).
- To enable energy cost reporting, you must enter an average dollar cost per kWh in the Administration General Settings. For example, enter \$.11/kWh to use \$.11 as the cost setting for all energy reports (see page 75 for details).
- All cost and usage graph reports - if the chart style is line or area - show baseline analysis data. The baseline analysis feature compares historical data from the Intelligent Lighting System versus the energy usage of the previously installed lighting system, and versus an LED system with lights ALL ON.
- To enable baseline reporting, you must enter a value, in total watts, for the previously installed lighting system in the Administration General Settings. For example, enter 11,160 W if the previous system comprised 24 x 465 W lights (see page 75 for details).

Facility Map Controls


Use the following controls to customize a facility map report:



Use the *toggle button* to switch between rooms view and status view.

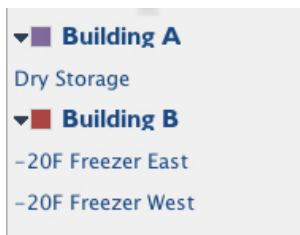

The *legend* lists each room and zone in the facility. Rooms are color-coded: All lights in the same room appear have the same color on the map. Click a room to expand the zone list for that room. Click a zone to highlight all lights in that zone.



When you click on a light or gateway icon, that device's quick-view popup appears. The popup shows the name and zone assignment. The status icon indicates if the device is actively communicating with LightRules (green icon), if the device has not communicated with LightRules in 24 hours (yellow icon), or if the device is out of sync or has never communicated with LightRules (gray icon). Click on the status icon to ping the device and update its status in the map. Additionally, if you click on the name, the configuration page for that device appears. Note that the yellow tab in the upper-left or upper-right corner of the popup points to the device whose information is being displayed.



Click anywhere on the *zoom control* to zoom in or out.




In the lower-right corner of the map, click-and-drag the *re-size control* to re-size the map window.

Adjust the Facility Map Color Scheme

In some instances, to enhance the clarity of the data in a facility map report, you may want to increase or decrease the intensity of the color saturation:

1. Click the **Reporting** tab and select a "Facility Map" report template from the dropdown list.
2. Use the left slider handle to adjust the blue saturation.
3. Use the right slider handle to adjust the red saturation.

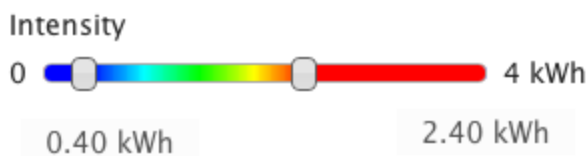


Adjust the Facility Map Data Radius

To enhance the clarity of the data in a facility map report, you may want to increase or decrease the radius of the data displayed for each light:

1. Click the **Reporting** tab and select a "Facility Map" report template from the dropdown list.
2. Use the radius slider to adjust the radius of the data for each light until you reach the desired level.

Radius



8



Note: Use a screen capture or print screen utility to print facility map reports.

Chapter Six:

Configuration

Configuration



User Considerations: Configuration features require **Operations** or **Administration** "User Permissions" (see page 15).

During system setup, the installer configures LightRules based on a hierarchical structure. There are four levels to the hierarchy:

1. **Lights:** Each light has a built-in microprocessor that enables software control and assignment to a zone. LightRules identifies lights by their serial numbers.
2. **Zones:** Zones are groups of lights. When you configure a zone, you assign a rule that specifies the dimming levels and occupancy sensor settings for the lights assigned to that zone.
3. **Rooms:** Rooms correspond to the physical spaces in your facility such as "-20F Freezer," "Dry Storage," and so on. Each room contains one or more zones. LightRules uses room assignments to generate reports.
4. **Networks:** A network is a group of ≤ 50 lights, not separated by any walls, and managed by a single gateway. LightRules uses networks to manage wireless communications and tracks those networks according to unique Network IDs.



Tip: The rule assigned to a zone applies to all lights in that zone, controlling all lights' behavior. LightRules does not assign settings to individual lights. However, you can create a zone containing a single light, effectively controlling just that light.

Typical Configurations

Following installation, with your lighting system up and running, you will most likely perform these configuration tasks:

- "Working with Zones" (see page 57)
- "Working with Profiles" (see page 59)
- "Edit Light Settings" (see page 61)

Optionally, over time, you may also perform these configuration tasks:

- Working with "Daylight Harvesting-Enabled Lights" (see page 62)
- Working with "Coordinated Control Lights" (see page 63)
- "Edit Rooms" (see page 64)
- "Working with Control Stations (NEW)" (see page 65)
- "Manage the Map File" (see page 72)



Note: For configuration instructions covering the optional LightRules Keypad, go to "LightRules Keypad" (see page 102). For instructions covering the optional LightRules Power system, see the LightRules Power topic.

Working with Zones

 DIGITAL LUMENS LIGHTRULES

Welcome, DL Admin [Logout](#)

[Dashboard](#) [Map](#) [Configuration ▾](#) [Calendar](#) [Manual Control](#) [Analysis](#) [Reporting ▾](#) [Administration ▾](#)

All Zones

Name	Light count	Avg. Daily kWh	Room	Network	
Row A	3	0.69	Room A	B13	Coord Edit
Row B	3	1.96	Room B	B13	Coord Edit
Row C	2	1.96	Room C	B13	Edit
Row D	2	2.57	Room D	B13	Edit
Row E	3	0.93	Room E	B13	Coord Edit
Row F	3	0.58	Room F	B13	Edit
Zone 0002	0	n/a	Default Room	D09	Edit
Zone 0003	0	n/a	Default Room	A01	Edit

[New Zone](#)

© Copyright 2010–2012 Digital Lumens – All Rights Reserved | [about](#) | [license](#) | [help](#)
2.0.0b12

The following sections outline how to create, edit, merge, and split zones.

Creating a New Zone

1. Click the **Configuration** tab and select **Zones**.
2. Click **New Zone**.
3. Type a name for the zone.
4. Select the appropriate Network ID (gateway) from the dropdown list.
5. Select the appropriate room from the dropdown list.
6. (Optional) Check **ignore occupancy sensors** if a set of lights have sensors that must be disabled due to an unusual installation circumstance (such as large fans moving within the range of the motion). For zones with this flag, the level sliders in the profile editor show only a single slider to set both Inactive and Active levels.
7. (Optional) Check **safety lighting** to activate the minimum active / inactive light level specified in Administration General Settings (see page 75).

8. (Optional) Check **coordination enabled** to permit coordinated control for the zone (for more information on coordinated control, see page 60).
9. (Optional) Type a text description of the zone.
10. Click **Create Zone**.



Tip: The new zone becomes active when you (a) add lights to it and (b) schedule a profile containing the new zone.

Editing an Existing Zone

1. Click the **Configuration** tab and select **Zones**.
2. Within the row of the zone you wish to modify, click **Edit**.
3. (Optional) Change the zone's room assignment.
4. (Optional) Check **ignore occupancy sensors** if the facility chooses not to use occupancy sensing.
(Optional) Check **safety lighting** to activate the minimum active/inactive light level specified in Administration General Settings.
5. (Optional) Check **coordination enabled** to permit coordinated control for the zone (for more information on coordinated control, see page 60).



Note: When a zone is coordination enabled, "**coord**" appears in that zone's row within the All Zones list. This setting locally enables/disables coordinated control for all lights assigned to the effected zone. Note that there is a global setting that enables/disables coordinated control for the entire system. Go to "Editing Date and Time Settings" (see page 83) for more information.

Maps with coordinated control generally have a greater number of zones because the light(s) designated as coordination master within a zone trigger all of the other lights in that zone. Therefore, if a zone — with coordinated control enabled — has 500 lights, all 500 lights are triggered by a single coordination master. This may or may not be preferable to the facility.

6. (Optional) Change the text description.
7. Click **Update Zone**.
8. "Perform a Sync" (see page 73).

Merging Two Zones

With the merge feature, you can combine two zones with the same Network ID into a single zone:

1. Click the **Configuration** tab and select **Zones**.
2. Within the row of the zone you wish to merge into another zone (the zone you select here will disappear after the merge), click **Edit**.
3. Click **Merge**.
4. Select the destination zone from the dropdown list on zones with the same Network ID.
5. Click **Merge**.
6. "Perform a Sync" (see page 73).



Note: When you merge zones, the rule of the destination zone is retained.

Splitting a Zone

With the split feature, you can split a single zone into two separate zones. This is a quick way to change the zone rule for a subset of a zone:

1. Click the **Configuration** tab and select **Zones**.
2. Within the row of the zone you wish to split, click **Edit**.
3. Click **Split**.
4. Name the new zone and select the lights you want to add to that zone.
5. Click **Split**.
6. "Perform a Sync" (see page 73).

Working with Profiles

Each light is set up with a default profile during commissioning. To use the LightRules calendar and create a lighting schedule that automates your facility's lighting management, you first have to set up one or more additional profiles.

New Profile

Name

Daytime - Holiday

Description

This short summary will be displayed in the Calendar and Dashboard.

Zone	Gang	Inactive	Active	Delay (sec)
Rack A	☐	0	90	90
Rack B	☐	0	100	120
Rack C	☐	10	83	120

[Add Rule](#)

[Save](#)

[All Profiles](#)



Note: To create a profile, you first have to create zones. Go to "Working with Zones" (see page 57) for more information.

Creating a New Profile

1. Click the **Configuration** tab and select **Profiles** from the dropdown list.
2. Click **New Profile**.
3. Type a name for the profile.
4. Select a zone.
5. Modify the rule set for the selected zone:
 - Use the right slider to adjust the active power level (20 -100).
 - Use the left slider to adjust the inactive power level (0 - 100).
 - Enter the desired sensor delay (minimum 30 seconds).
6. Click **Add Rule** and then repeat step 5 for all desired zones.
7. Click **Save**.



Note: The active power level has a minimum level of 20, for safety purposes.

Creating a New Facility-wide Profile

1. Click the **Configuration** tab and select **Profiles**.
2. Next to the default profile, click **Clone Profile**.
3. Modify the rule set, as desired, for each zone.
4. Click **Save**.

Editing or Cloning an Existing Profile

1. Click the **Configuration** tab and select **Profiles**.
2. Within the row of the profile you wish to modify, click **Edit** or **Clone**.
3. Modify the rules for each zone, as desired.
4. Click **Save**.

Deleting a Profile

1. Click the **Configuration** tab and select **Profiles**.
2. Within the row of the profile you wish to modify, click **Delete**.
3. Click **OK** to confirm deletion.



Note: You cannot delete a profile that is in use or scheduled in the calendar.

Edit Light Settings

DIGITAL LUMENS LIGHTRULES

English (US) Welcome, DL Admin Logout

Dashboard Map Configuration Calendar Manual Control Analysis Reporting Administration

Editing Light

Serial Number
00113CCC

Product
ILE-HB-3-65-15 (21200-00)

Name
CA-09

☐ Disable Control
LightRules will not attempt to change profile or collect usage information for this light. Useful when the fixture is known to be unreachable.

☐ Enable Daylight Harvesting

☐ Coordination Master

Zone
Most Cooler Night Lights
Light can only be moved to another Zone on the same Network.

Description
Programmed on Wed Nov 2 2011 at 10:36:15

Update Light

Show | All Lights

Move a Light to a Different Zone

1. Click the Configuration tab and select Lights.
2. Within the row of the light you wish to modify, click Edit.
3. Select a new zone from the dropdown list.
4. Click Update Light.
5. "Perform a Sync" (see page 73).



Note: You can move a light between zones with the same Network ID. If the desired destination zone has a different Network ID, you must use Commissioner software to make the change.

Rename a Light

1. Click the Configuration tab and select Lights from the dropdown list.
2. Within the row of the light you wish to modify, click Edit.
3. Type a new light name.
4. Click Update Light.
5. "Perform a Sync" (see page 73).

Disable Control

The Disable Control feature increases network speed when a light in the map is known to be missing, powered off, or experiencing connectivity issues. Only check this option for lights meeting the aforementioned conditions.

Daylight Harvesting-Enabled Lights

LightRules is compatible with daylight harvesting-enabled lights. During installation, installers perform daylight calibration on each enabled fixture using Digital Lumens Commissioner software.

In LightRules, you must perform both of the following steps to enable daylight calibrated lights.



Note: To control daylight harvesting-enabled lights with LightRules, you must first calibrate those lights with Digital Lumens "Commissioner Software" (see page 15).

Step 1: Enable Daylight Harvesting at the Global Level

1. Click the **Administration** tab and select **General Settings**.
2. Check the **Enable Daylight Harvesting** feature.

3. Click **Save Settings**.

Step 2: Enable Daylight Harvesting at the Fixture Level

1. Click the **Configuration** tab and select **Lights**.
2. Within the row of the light you wish to modify, click **Edit**.
3. Check the **Enable Daylight Harvesting** feature.
4. Click **Update Light**.
5. "Perform a Sync" (see page 73).



Note: Once you perform both steps, LightRules displays a "DH" next to each light that is actively daylight harvesting.

Disable Daylight Harvesting at the Profile Level

Once enabled for a fixture or zone, daylight harvesting is operating at all times by default. To turn off daylight harvesting for certain times, disable the function in a specific profile:

1. Click the **Configuration** tab and select **Profiles**.
2. Within the row of the profile you wish to modify, click **Edit**.
3. Check the **Disable DH** feature.
4. Click **Save**.

Coordinated Control Lights

LightRules is compatible with coordinated control-enabled lights. During installation, installers enable coordinated control and assign coordination masters using Digital Lumens "Commissioner Software" (see page 15).

In LightRules, you must perform the following two steps to enable coordinated control and then designate lights as coordination masters.

Step 1: Enable Coordinated Control at the Global Level

1. Click the **Administration** tab and select **General Settings**.
2. Check the **Enable Coordinated** feature.
3. Click **Save Settings**.

Step 2: Enable Coordinated Control at the Zone Level

1. Click the **Configuration** tab and select **Zones**.
2. Within the row of the light you wish to modify, click **Edit**.
3. Check the **Coordination Enabled** feature.
4. Click **Update Zone**.
5. "Perform a Sync" (see page 73).

Step 3: Designate a Light as a Coordination Master

A light designated with a coordination master flag will trigger all lights in its zone. After enabling coordinated control at the local and global levels, you can designate a light as a coordination master:

1. Click the **Configuration** tab and select **Lights**.
2. Within the row of the light you wish to modify, click **Edit**.
3. Check the **Coordination Master** feature.
4. Click **Update Light**.
5. "Perform a Sync" (see page 73).

Disable Coordinated Control at the Profile Level

Once enabled for a fixture or zone, coordinated control is operating at all times by default. To turn off coordinated control for certain times, disable the function in a specific profile:

1. Click the **Configuration** tab and select **Profiles**.
2. Within the row of the profile you wish to modify, click **Edit**.
3. Check the **Disable CC** feature.
4. Click **Save**.

Edit Rooms

As your facility floor plan changes over time, you may need to edit rooms in LightRules. LightRules utilizes the room designations you create in order to create detailed room reporting.

Create a New Room

1. Click the **Configuration** tab and select **Rooms**.
2. Click **New Room**.
3. Type a new room name and/or text description.

4. Click Create Room.
5. Edit one or more zones by assigning those zones to the new room.
6. "Perform a Sync" (see page 73).

Edit an Existing Room

1. Click the Configuration tab and select Rooms.
2. Within the row of the light you wish to modify, click Edit.
3. Type a new room name and/or text description.
4. Click Update Room.
5. "Perform a Sync" (see page 73).

Working with Control Stations (*NEW)

Control Stations provide users with limited knowledge of LightRules software the ability to manually override configuration of the lighting system within a designated area of the facility. This is most commonly used when a temporary need for higher levels of light for safety and improved visibility when performing tasks such as cleaning, maintenance, and responding to safety incidents.

Identifying Areas and Control Stations

To get started working with control stations, an Administrator needs to first plan control areas and stations.

Identifying Areas

The first step in configuring Control Stations is to identify the areas being controlled from each station. Each area contains one or more zones, and is implemented by creating a profile with the zones and proper settings.

Areas should not have overlapping zones, because it is not possible to tell from the Control Station screen which of two active profiles is effective for a given zone. Keep the areas distinct for maximum clarity.

Naming Profiles

Name profiles to identify the area, for example "Underbody 1" or "Frame Weld 7." Try to avoid redundant words like "operator," "station," or "override" in the profile names. Profile names must be less than forty characters.

For help creating profiles, go to "Working with Profiles" (see page 59).

Identifying Stations

Stations correspond to the physical locations of computers in the facility where an operator can control the lighting in the areas visible from that location.


Create stations and add profiles ordering them in a way that makes the best sense from the perspective of an operator standing at that station.

Enabling Control Stations



User Considerations: The following steps must be completed by a user with **Administrator** "User Permissions" (see page 15).

1. Select **Administration > General** and then click **Edit General Settings**.
2. Under **Feature Control**, select **Control Station Functionality**.

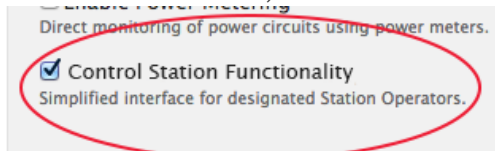

3. Click **Save Settings**.
4. Create profiles corresponding to the areas needed for each station (for help creating profiles, go to "Working with Profiles" (see page 59)).

Adding Control Station Users



User Considerations: The following steps must be completed by a user with **Administrator** "User Permissions" (see page 15).

The following list outlines user permission level functions for Control Stations. Users may have one permission level, or a combination of the three:

- Station Operator permission - start override, cancel override.
- Operations permission - start override, cancel override, access LightRules toolbar.
- Administration permission - user setup, add new stations, edit stations, delete stations, access LightRules toolbar.

To simplify login at Control Stations, configure dedicated Operator logins. For example, if the default login domain is *customer.com*, create a user with email *station1@customer.com*, assigning only the Station Operator user role, and create a password such as *station1*:

New User

Name

Control Station

Email

station1@customer.com

☐ Allow user to choose a password

☒ Set a password now

Password

.....

Password Confirmation

.....

Roles

☐ Reporting

☐ Operations

☐ Admin

☒ Station Operator

Go directly to Operator Stations page when this user logs in.

Phone

Create User

Using this method, anyone can then log in using the email *station1* and password *station1*, and will be shown the Control Station screen, with no other access to LightRules:

Control Station All Aisles – Individually

Aisle A – ON

☐

Aisle B – ON

☐

Aisle C – ON

☐

Aisle D – ON

☐

Aisle E – ON

☐

Aisle F – ON

☐

Note: LightRules toolbar navigation is removed for users with only Station Operator user permission. Users with Operations or Administration permissions can view the Control Station screen by selecting **Configuration > Control Stations** from the LightRules toolbar.

For more information about creating users, go to "Create a User Account" (see page 80).


Creating Control Stations



User Considerations: The following steps must be completed by a user with **Administrator** "User Permissions" (see page 15).


1. Select **Configuration > Control Stations**.
2. If no stations have been created, click **Create Control Station**. If stations have already been created, they will appear as a list on this page. Click **New** to create a new station.

The *New Control Station* page opens.

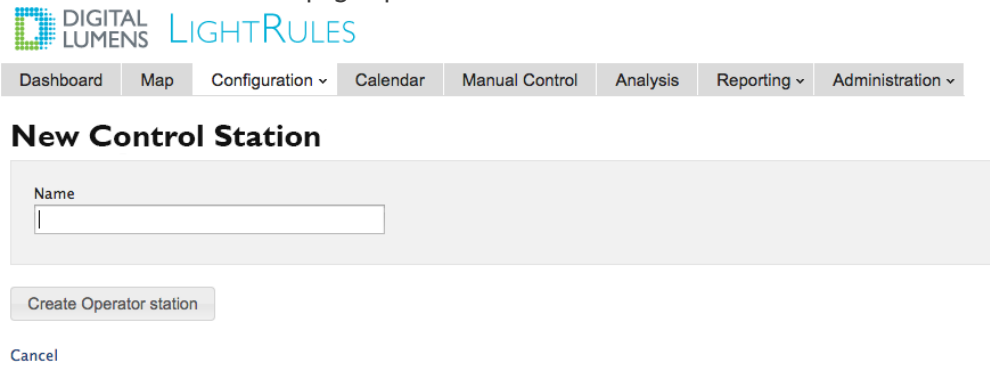


The screenshot shows the 'New Control Station' page. At the top is the 'DIGITAL LUMENS LIGHTRULES' logo. Below it is a navigation bar with tabs: Dashboard, Map, Configuration (selected), Calendar, Manual Control, Analysis, Reporting, and Administration. The main heading is 'New Control Station'. Below this is a form with a 'Name' label and an empty text input field. Under the input field is a 'Create Operator station' button. At the bottom left is a 'Cancel' link.

3. Enter a name for the station, and click **Create Control Station**. Once created, the *Control Station* page opens.

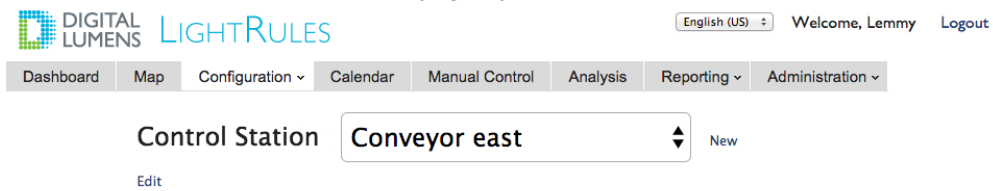


The screenshot shows the 'Control Station' page. At the top is the 'DIGITAL LUMENS LIGHTRULES' logo. To the right of the logo are links for 'English (US)', 'Welcome, Lemmy', and 'Logout'. Below the logo is a navigation bar with tabs: Dashboard, Map, Configuration (selected), Calendar, Manual Control, Analysis, Reporting, and Administration. The main heading is 'Control Station'. Below this is a dropdown menu showing 'Conveyor east' with a plus sign icon. To the right of the dropdown is a 'New' button. Below the dropdown is an 'Edit' link.

4. Click **Edit**.
5. Click the plus sign to add an area to the station.

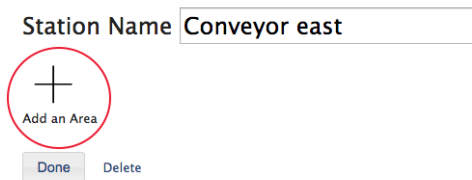

The screenshot shows the 'Add an Area' dialog. At the top is a 'Station Name' label and a text input field containing 'Conveyor east'. Below the input field is a circular button with a plus sign icon and the text 'Add an Area'. At the bottom are two buttons: 'Done' and 'Delete'.

6. Select a Profile from the dropdown list.

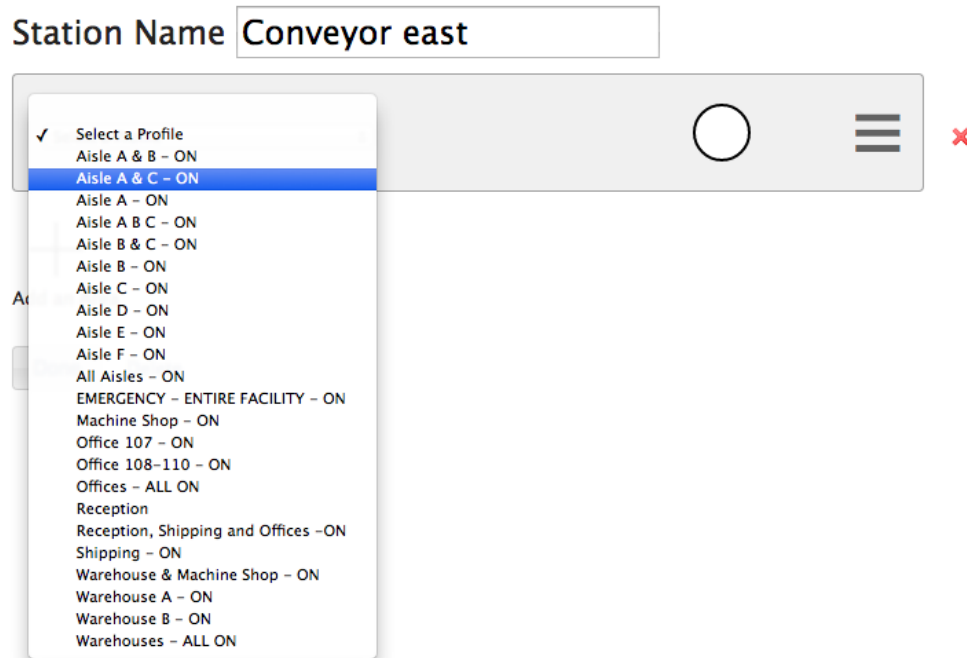

7. Click and drag the gray lines to rearrange areas.
8. Delete an area by clicking the red X.
9. When you are finished adding areas, click **Done**.

Deleting Control Stations



User Considerations: The following steps must be completed by a user with **Administrator** "User Permissions" (see page 15).

1. Select the station you wish to delete.
2. Click **Edit**.

3. Click Delete.

Station Name

Aisle A – ON

⋮

×


Add an Area

 **Note:** Deleting a station does not cancel any override profiles that are currently active.

Starting an Override

 **User Considerations:** The following steps must be completed by a user with **Station Operator** or **Operations** "User Permissions" (see page 15).

1. Select a Control Station from the drop down list at the top of the screen.
2. Click the white circle next to the desired area.
An override is started with a one hour duration.




Control Station

Aisle A – ON

1:00

×


Override Started
One hour override started for Area 'Aisle A – ON'

3. Click the green button to add another hour to the override.




Control Station

Aisle A – ON

1:59

×


Override Extended
One hour override added for Area 'Aisle A – ON'

When the countdown reaches 0:00, the profile is reverted and the button returns to the white “not active” state.




Note: If a profile is pushed using “Manual Control” (see page 32), the station is updated if it contains affected areas.

Canceling an Override



User Considerations: The following steps must be completed by a user with **Station Operator** or **Operations** “User Permissions” (see page 15).

Click the red “X” to cancel the override.

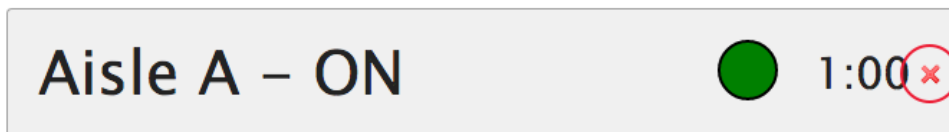

When the override is canceled, the profile is reverted and the button returns to the white “not active” state.

Manage the Map File

During LightRules installation, the installer uses building drawings and information gathered during the planning process to create a map file specific to your facility. The map is created with Commissioner software. The map file is a configuration file containing all fixtures, zones, gateways, and rule sets, and it contains all of the configurable settings LightRules needs to perform manual control, automated control, and reporting. Networks, rooms, zones, lights, coordinated control settings, and daylight harvesting settings are also configured during system installation. All settings are distilled into the map file.

When you make changes to zones, lights, rooms, keypads, power meters, or power gateways, you are effectively changing the map file. When you make these changes, Commissioner software is used to perform the programming.



Tip: You will need to use Commissioner software to move lights from one network to another, move the visual position of a light in the facility map, and/or update the facility map background image.

Downloading the Map File

Commissioner requires the latest version of the map file before any new programming work can occur.

To download (save) the map file, follow these steps:

1. Click the **Configuration** tab and select **Manage Map File**.
2. Click **Download**.
3. Browse to the desired save location, and then click **Save**.

Back up the Current Map File (*NEW)

If site configuration is enabled, the map file is automatically saved once per day following changes. To start an immediate backup:

1. Click the **Configuration** tab and select **Manage Map File**.
2. Click **Back Up**.

For more information on site configuration, go to "Enable Site Configuration (NEW)" (see page 89).

Uploading the Map File

(After editing the map file in Commissioner, you must upload the updated file to LightRules:


1. Click the **Configuration** tab and select **Manage Map File**.
2. In the *Upload Map File* section, click **Choose File** to browse to the desired save location
3. Click **Upload**.
4. "Perform a Sync" (see page 73).

Perform a Sync

When you update a room, zone, or light, you have changed the map file and LightRules requires a sync operation to push the new settings over the lighting network to the lights in the facility. LightRules displays a prompt when one or more pending map file changes require syncing; you can sync more than one change at a time.

Syncing the Map File

1. On the dashboard, in the *Map Changes Pending* prompt, click **Sync** or **Revert**

A dark gray rectangular prompt box with rounded corners. It contains the text "Map Changes Pending" in bold white font, followed by "Sync or Revert" in yellow font, and "pending map changes." in white font.

Map Changes Pending
Sync or Revert pending map changes.

2. Review the description of the pending map file changes.
3. Click **Sync** to push the new settings to the lights,
- or -
click **Revert** to cancel all changes.
4. Click **OK**.

Chapter Seven:

Analysis

Analysis



User Considerations: The analysis features requires **Reporting** "User Permissions" (see page 15).

LightRules utilizes scheduled profiles to automate lighting. Each profile contains a set of zones, which in turn specify the settings – active power level, inactive power level, and sensor delay – that are designed to optimize energy usage.

Using historical data, the analysis tool provides predictive insights that help LightRules administrators further refine the active power level, inactive power level, and sensor delay settings and thus reduce energy usage.


How it Works

- LightRules takes historical data from a specified period of time, for a selected profile and graphs a chart line showing the measured energy cost, energy usage, or active %.
- In order to get the best estimates, you should select the profile which best represents how the selected lights were configured during the Analysis Date Range. This may be the Default Profile, or possibly a different profile.
- LightRules displays sliders for sensor delay, active power level, and inactive power level. The initial values are obtained by averaging the settings across all the lights in the selected profile.
- As the user changes the slider settings, LightRules graphs a new chart line showing what the estimated energy cost, energy usage, or active % would be if those settings were implemented.
- The user can then refine the report by selecting a specific room or zone.
- Based on the settings identified in the analysis, an administrator could then evaluate existing profile settings edit some or all profiles accordingly.



Tip: When adjusting the active level, keep in mind that there is a minimum acceptable light level for the facility. Use a light meter to identify the minimum acceptable light level before making permanent changes to zones.

Running a What-if Report

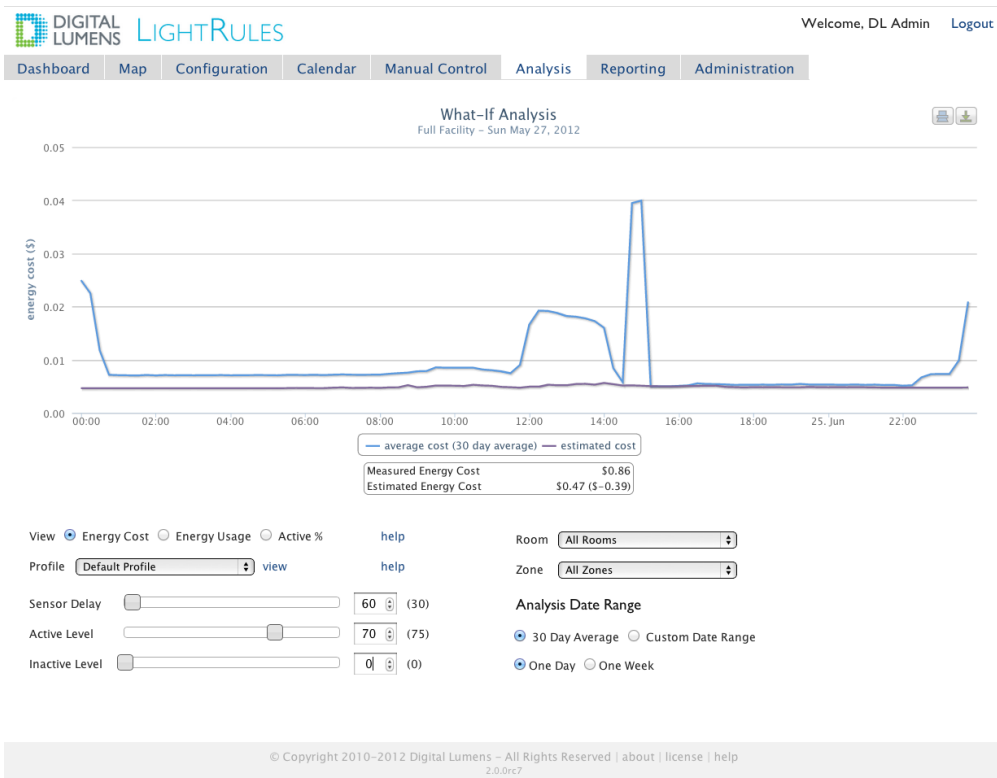

1. Click the **Analysis** tab.
2. Select one of the following report types:
 - **Energy Cost:** Creates a comparative analysis of measured data versus predicted data, in dollars.
 - **Energy Usage:** Creates a comparative analysis of measured data versus predicted data, in kWh.
 - **Active %:** Displays the amount of time that lights will be in active mode, based on the sensor delay.
3. Select the most frequently used profile.
4. Adjust the sliders to graph the estimated difference with the new settings applied.
The numbers in parentheses indicate the starting settings.
5. (Optional) Enter a new date range.
6. (Optional) Click the print icon to print the report.
7. (Optional) Using the settings on the printed report, edit the profile accordingly.

Chapter Eight:

Administration

Administration



User Considerations: Administration features require **Administration "User Permissions"** (see page 15)

From the Administration tab, you can create and edit user accounts, edit LightRules settings, and backup and restore your LightRules system.

Administrative functions

- "User Accounts" (see page 80)
- "Edit Settings" (see page 81)

User Accounts

LightRules Administrators can create, delete, and edit user accounts.

The screenshot shows the LightRules Administration interface. At the top, there's a navigation bar with tabs: Dashboard, Configuration, Calendar, Manual Control, Reporting, and Administration (selected). The 'All Users' section is active, displaying a table with columns: Name, Email, Role, and Last Access. Below the table is a 'New User' button. The footer contains copyright information: © Copyright 2010-2011 Digital Lumens - All Rights Reserved | about | license | help 1.6

Name	Email	Role	Last Access
Brad	02@digitallumens.com	Reporting, Operations, Admin	21 Jul 2011 09:05AM
DL Admin	rules@digitallumens.com	Reporting, Operations, Admin	17 Feb 2011 09:15AM
Installer	rules+installer@digitallumens.com	Operations, Admin	20 Jul 2011 02:56PM

Create a User Account

1. Click the **Administration** tab and select **Users**.
2. Click **New User**.
3. Enter the **user name**.



Tip: Use a consistent naming convention for all LightRules users.

4. Enter the **user's email address**.
5. (Optional) Select **Set a password now** if the LightRules system is stand-alone and not connected to the facility's enterprise network.
6. Select one or more permission levels by checking the corresponding boxes.
7. Enter the user's phone number for future reference by the system administrator (optional).
8. Click **Create User**.

After creating the account, the new user will receive an invitation email from LightRules. The invitation email contains login details and a link to the LightRules login page.

Edit an Existing User's Permissions

1. Click the **Administration** tab and select **Users**.
2. In the row of the user account you wish to modify, click **Edit**.
3. Edit user parameters as desired.
4. Click **Update User**.

Change a User's Password

1. Click the **Administration** tab and select **Users**.
2. In the row of the user account you wish to modify, click **Edit**.
3. Click **Change password**.
4. Enter the new password and then re-enter to confirm.
5. Click **Update User**.

Delete a User Account

1. Click the **Administration** tab and select **Users**.
2. In the row of the user account you wish to modify, click **Delete**.
3. Click **OK** to confirm deletion.

Edit Settings

Administrators can edit various settings in LightRules such as default language, date, time, SMTP email, and network information.

Editing General Settings

DIGITAL LUMENS LIGHTRULES

Dashboard Map Configuration Calendar Manual Control Analysis Reporting Administration

Edit General Settings

Facility Name
PM LRA

LightRules hostname
[Empty]

Used to generate links to this LightRules server in email. Use a properly configured DNS address, or LEAVE THIS BLANK.
Default login domain
gm.com

Set your domain here to allow 'buddy@northpole.com' to login with just 'buddy'.

Default Language
English (US)

Currency locale
United States Dollar (\$)

Use Metric Units
No

Select whether temperature should be displayed in Metric units (°C).

Admin Contact
DL Admin

Facility Manager
[Empty]

Facility IT Contact
[Empty]

Reseller Group
[Empty]

Reseller Contact
[Empty]

Minimum Active Level
20

Minimum active level for lights. This is a safety feature.

Safety Lighting Minimum Level
20

Minimum active and inactive level for lights in designated Safety zones. Typically used for emergency exit lighting.

Rescue workers
4

Number of active background workers. Min: 1, Max: 32, Default: 4

Feature Control

☐ Enable Daylight Harvesting
None of 7 fixtures have been daylight calibrated.

☒ Enable 2d Mapping and Reporting
A Map file with 2d mapping information must be loaded before these features will be visible.

☐ Enable Coordinated Control
Coordinated control (synchronized active state) for designated zones.

☐ Enable Power Metering
Direct monitoring of power circuits using power meters.

☒ Control Station Functionality
Simplified interface for designated Station Operators.

☒ Enable Battery Backup Testing
If lights fixtures with battery backup are present, enable monthly and annual battery tests.

This section explains how to edit general settings in LightRules, such as the default language and currency. Most of the general settings should be configured during installation, however, you may edit the following settings at any time:

1. Click the **Administration** tab.
2. Select **General**.
3. Click **Edit General Settings**.
4. Modify settings as desired:
 - **Default Language:** During system installation, the installer specifies a default language setting and also the currency type. If a user wants to change the language setting for his or her individual user session, he or she can make a new language selection at login, and the language selection will remain active until that user logs out:

- **Currency Locale:** Language and currency are independent. For example, changing the language from English (US) to French does not alter the default currency.
- **Admin Contact:** All user-related messages are sent from the Admin Contact's email address. For example, the invitation email sent to every new user is sent from the Admin Contact. The Admin Contact is editable.
- **Safety Lighting Minimum level:** As needed, enter the correct time and date.
- **Feature Control:** Check the boxes for each setting to toggle the feature On or Off at the global level.
- **Energy Cost per kWh:** Enter an estimation of the facility's average energy cost to enable LightRules to report energy cost over time.



Note: LightRules does not currently support variable energy rates such as time-of-use or peak demand rates.

- **Old Power Estimate:** To enable baseline reporting, you must enter a value in total watts, for the previously installed lighting system.



Tip: The Old Power Estimate feature requires an entry of W (Watts), rather than an entry of kWh (kilowatt hours). Note that this function assumes 24 x 7 operation at constant power.

- **Room/Zone Summary Metric:** Change this value to change what appears in the Configuration tab, under rooms and zones. For example, by default, LightRules displays [Avg. Daily kWh] for each room and zone.

5. Click **Save Settings**.

Editing Date and Time Settings

1. Go to **Administration > Date & Time**.
2. Click **Edit Date/Time Settings**.
3. Modify settings as desired:
 - **Time Zone:** Select the appropriate time zone from the dropdown list.
 - **Modify the First Calendar Day:** Change this value to specify the day that the calendar should begin each week. By default, the week starts on Sunday.
 - **Use NTP to Manage the Clock (NEW):** Use this option if you have enabled TLS Web Connections, as the TLS protocol may fail if the LRA clock drifts too far from the correct time. Enabling NTP in LightRules allows the LightRules Appliance to keep accurate time.
When enabled, the *Set System Clock* option is removed, and a configuration option for custom NTP servers is presented:

Editing Date/Time Settings

Time Zone
(GMT-05:00) Eastern Time (US & Canada)

First Calendar Day
Sunday

☒ Use NTP to manage the clock

NTP Servers

Hostnames or IP Addresses separated by spaces. Leave blank for default pool.ntp.org servers.

Currently
Time Zone: Eastern Time (US & Canada)
June 10, 2015 08:28 PM

Save Settings

Cancel

Leave the **NTP Servers** field blank to use NTP servers maintained by the Network Time Foundation. To specify NTP servers in your network infrastructure, enter the IP addresses or hostnames of the servers separated by spaces.



Note: NTP is not available in Stand-alone Console Mode.

- **Set System Clock:** If not using NTP, select this option and then enter the correct time and date.

4. Click **Save Settings**.

Email Server Settings



Note: By default, LightRules uses the cloud-based Digital Lumens email server to send emails to users. Therefore, in most cases, the email server settings should be left blank. When you enter email server settings, you are effectively overriding the default email configuration.

If the facility requires custom SMTP email server settings, use the following steps:

1. Go to **Administration > Email Server**.
2. Select **Edit**.
3. Modify settings as desired, based on information supplied by the facility IT department.
4. Click **Save Settings**.

Editing Networks and Firmware

During installation, for instructions on configuring network settings and firmware, refer to the

[LightRules Appliance Installation Instructions](#) document available at digitallumens.zendesk.com (you must have a Zendesk account and be signed in to view this document).

Post-installation, "Contact Digital Lumens Technical Support" (see page 16) before altering the network or firmware settings.

Battery Backup Tests (*NEW)



Note: To access Battery Backup tests, enable them at the General Settings level. To do this, go to **Administration > General**, and then select **Enable Battery Backup Testing** in the *Feature Control* section.

Battery Backup tests allow administrators to test emergency lighting on an interim or scheduled basis to ensure the safety of facilities and employees in the event of a power outage or emergency. To access battery backup tests:

1. Go to **Administration > Battery Backup Tests**

Battery Backup Tests

[Initiate a Battery Backup Test](#)

Scheduled Tests

Test Type	Summary	Next Scheduled		
Short	Monthly on the first Sunday at 02:00 AM	August 02, 2015 02:00 AM	Edit	Delete


Completed Tests

Start Time	Test Type	Summary	
July 14, 2015 09:45 AM	Short	Not started (no lights)	show download
July 09, 2015 03:59 PM	Short	Not started (no lights)	show download
July 09, 2015 11:13 AM	Long	Not started (no lights)	show download
July 09, 2015 11:13 AM	Short	Not started (no lights)	show download
July 07, 2015 11:25 AM	Short	Not started (no lights)	show download

Start a battery backup test now

1. On the *Battery Backup Tests* screen, click **Initiate a Battery Backup Test**. The *Initiate a Battery Backup Test* screen opens:

Initiate a Battery Backup Test

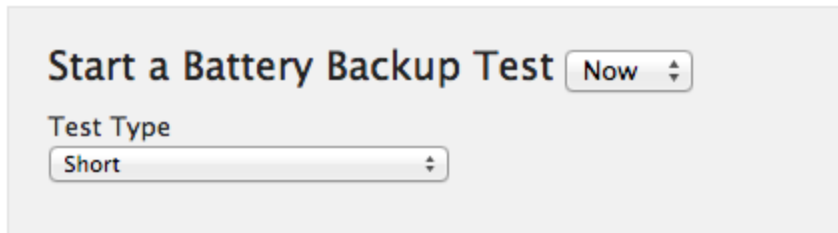

Start a Battery Backup Test Now

Test Type

Short

Save

[Cancel](#)

2. Select **Now**.
3. Select **Short** or **Long** as the test type.
4. Click **Save**.

A message appears on the screen indicating a test has started.

Schedule a battery backup test for later

1. On the *Battery Backup Tests* screen, click **Initiate a Battery Backup Test**. The *Initiate a Battery Backup Test* screen opens:

Initiate a Battery Backup Test

Start a Battery Backup Test

Later ▾

Test Type
Short ▾

Frequency
Yearly ▾

Month of year
January ▾

Week of month
first ▾

Weekday
Sunday ▾

Start Time
02:00 AM

Save

[Cancel](#)

2. Select **Later**.
3. Select **Short** or **Long** as the test type.



Note: Long tests can only be scheduled for one time. The **Frequency** field is removed when scheduling a Long test.

4. Select a **Frequency** if scheduling a Short test.
5. Enter or select all **Date** parameters.
6. Enter a **Start Time**.
7. Click **Save**.

A message appears on the screen indicating a test has been scheduled. The new test also appears in the *Scheduled Tests* list.



Note: Edit or delete a scheduled test from the main Battery Backup Tests screen by selecting either Edit or Delete next to the test you wish to change.

Download battery backup test reports

In the *Completed Tests* section on the Battery Backup Tests screen:

1. Select **show download** next to the test you wish to view. The *Battery Backup Test Report* screen opens:

Battery Backup Test Report

Test Type: Short

Started at: July 09, 2015 11:13 AM

Status: No Nodes

Completed at: July 09, 2015 11:13 AM (0h00m)

[download](#)

Serial No. ◆	Name ◆	Room ◆	Result ◆
--------------	--------	--------	----------

[All Reports](#)

2. Click **download** to view a csv copy of the report.

Backup and Restore

LightRules automatically performs nightly backups and also offers a feature allowing you to save data to an external hard drive. Administrators can then restore from a backup for a full system recovery. LightRules offers a backup feature with which you can save data to an external hard drive, and then recover that data if, for some reason, the LightRules Appliance fails.

1. Choose a USB hard drive that is at least 8 GB (preferably 16 GB) and supports USB 2.0.
2. Plug the hard drive into a Windows® or Macintosh computer.
3. Verify that the hard drive is formatted for a EXFAT file system (this is typical for USB drives).
4. Set the Volume Name of the drive to **LRA-BACKUP**. This is typically done in the Windows® Properties dialog or the MacOS Get Info dialog (refer to your operating system help documentation for additional details).
5. Create a folder at the top level of the hard drive named **Backups**.
6. Eject the hard drive from the computer.

7. Plug the hard drive into any open USB port on the LRA. Note that there are USB ports on both the front and back of the computer. The ports on the back may be less likely to be accidentally disconnected.
8. Try a manual backup to verify that the disk drive is configured correctly.

Backup Process

If a backup drive is connected to the LightRules appliance, then LightRules automatically performs nightly backups at 3:30am. To keep the backup disk from filling up, backups older than 30 days may be automatically removed from the backup disk.

1. Click the **Administration** tab and select **Backups** from the dropdown menu.
2. Click **Backup Now**. The backup process typically takes 15-30 minutes, but may take longer for large databases.
3. The backup has finished when the State column indicates "Complete".

Restore Process

Only restore from a backup for full system recovery. We do not recommend restoring for the sole purpose of reverting configuration changes, as restoring will permanently discard usage history.

1. Click **Administration > Backups**.
2. In the list, select the backup from which you would like to restore, and then click **Restore**.
3. Click **Yes** when prompted.
The maintenance screen appears, signifying the beginning of the restore process, which takes about 15-30 minutes.
4. Once the restore has completed, the LightRules Appliance will automatically reboot and you will be directed to the login screen. You may now continue using LightRules.
 - Network configuration will be restored (i.e., IP address)
 - Log in using the restored email and password login information from the original backup.

Enable Site Configuration (🌟NEW)

LightRules 2.11 provides the option to store map file and user interaction data to Digital Lumens cloud service. When enabled, changes to the map file, lighting configuration, and user interaction are automatically saved, allowing for rapid recovery of the light system in case of appliance failure. By default, site configuration is saved once per day following changes. To enable site configuration:

1. Click **Administration > General**.
2. Click **Edit General Settings**.

3. Check **Enable Site Configuration Backup and Interaction Data Collection** under *Feature Control*.
4. Click **Save Settings**.

Upload Product Profile

Digital Lumens offers a range of lighting products and gateways. To ensure that LightRules has latest product information in its database, you can upload the latest version of the product spec file.

"Contact Digital Lumens Technical Support" (see page 16) Digital Lumens to request the latest product spec file.

Shutdown

To ensure that your LightRules database is not damaged, "Contact Digital Lumens Technical Support" (see page 16) prior to using the LightRules Appliance shutdown administrative command.

Chapter Nine:

Diagnostics

Diagnostics



User Considerations: The diagnostic features require **Admin** and **Operations** "User Permissions" (see page 15).

LightRules continually checks the lighting network for connectivity and/or changes to the map file that have not been received by the lights. If there are no issues, LightRules displays "All Clear" on the diagnostics screen.

If there is an issue, LightRules identifies the affected portion of the network and displays an alert icon. Additionally, if LightRules Power is in use, LightRules checks the connectivity of all power meters and power gateways. Access the diagnostics screen by selecting **Configuration > Diagnostics**:

Diagnostics

Lighting Network

Running

Network Interfaces (All Clear)

Networks (All Clear)

Light Fixtures (7)

Last scanned

Serial No.

Name

Network

Product

Start Date

06000037

DLA 037

Network H06

DLA-LLE

DH

Edit

0300534E

ILE 534E

Network E14

ILE-3-13, Wide optic (22300-05)

Sep 09 2013

DH

Edit

05 Aug 03:57 PM

0300531F

ILE 531F

Network E14

ILE-3-13, Wide optic (22300-05)

Sep 11 2013

DH

Edit

06 Aug 01:44 PM

0600005E

DLA 5E

Network H06

DLA-I

Aug 04 2014

DH

Edit

27 Aug 11:50 AM

0600002D

Matt LLE 2D

Network F06

DLA-LLE-S

Aug 05 2014

Edit

28 Aug 12:07 PM

06000064

DLA 064

Network H06

DLA-I

Aug 04 2014

DH

Edit

28 Aug 01:05 PM

06000005

DLA 005

Network E14

DLA-LLE

Aug 04 2014

CC

Edit

Light Fixtures (5)

Serial No.

Network

Expected Network

Timestamp

03FFC033

F06

-

03 Sep 10:43 AM

060000A8

F06

-

03 Sep 10:43 AM

0600007F

F06

-

03 Sep 10:43 AM

03003171

F06

-

03 Sep 10:43 AM

06000033

F06

-

03 Sep 10:43 AM

06000062

F06

-

03 Sep 10:43 AM

Uncalibrated Devices (1)

Serial No.

Name

Timestamp

Start Date

0600002D

Matt LLE 2D

27 Aug 11:50 AM

Aug 05 2014

06000037

DLA 037

Keypads (1)

Serial No.

Name

IP Address

Timestamp

74000944

Keypad Cold Storage 1

192.168.1.24

Edit

Delete

Power Gateways (All Clear)

Power Gateways in alerted state

Power Meters (All Clear)

System Health

All Networks

All Lights

All Keypads

All Power Gateways

All Power Meters

Diagnostic Alerts

The diagnostics screen displays seven categories of alerts:

1. **Network Interfaces** - Summarizes any issues with the Ethernet portion of the lighting network. An alert indicates an issue with a network switch or cable.
2. **Networks** - Summarizes any communication issues with the wireless portion of the lighting network. An alert indicates a gateway hardware issue or a change to the map file that has not been synced.

3. **Light Fixtures** - Summarizes any communication issues with individual lights. An alert indicates a light hardware issue or a change to the map file that has not been synced.
4. **Uncalibrated Devices** - Lists all DLA devices requiring additional programming. DLA programming is performed using Digital Lumens Commissioner software.
5. **Keypads** - Displays any communication issues with the keypads. An alert indicates a hardware issue.
6. **Power Gateways** - Displays any communication issues with individual power gateways. An alert indicates a hardware issue (power gateway configuration changes do not require a sync).
7. **Power Meters** - Displays any communication issues with individual lights. An alert indicates a hardware issue (power meter configuration changes do not require a sync).

Diagnostic Actions

In many instances, pinging the device will refresh its state and clear the alert. To ping a device:

1. Mouse over the alert icon for a description of the alert state.
2. Click the icon to ping the affected network or device.
3. When the icon refreshes, if the alert state changes to a green check mark, then the network or device is functioning normally and no further action is required.

If the alert state does not change, then do the following:

- Verify that the device is powered (by observing the device's indicator LED).
- Use the "Discover Feature" (see page 93) to determine if there has been a hardware change. If a new device is discovered by LightRules, you must update the map file using Commissioner software from Digital Lumens.
 - or -
- If the hardware has not changed, reboot the hardware associated with the alert.

If the alert still appears after you perform the above steps, "Contact Digital Lumens Technical Support" (see page 16).

Discover Feature

When new light, gateway, keypad, or power gateway has been installed, you can identify the new hardware via the discover diagnostic feature.



Note: A new light from the factory will be assigned the default Network ID, "Factory Default Network." Prior to installation, the light must be configured with a new Network ID via Commissioner software (see the Commissioner 2.11 Admin Guide for details).

Discover a New Light

1. Click the **Configuration** tab.
2. Select **Networks** from the dropdown list and click on the Network ID you believe contains the light.
3. Click **Discover Lights**.
4. LightRules indicates a newly discovered light (return to step 2 if no lights are discovered).
5. The map file needs to be updated. Use [Commissioner software](#) to update the map file.

Discover a New Gateway

1. Click the **Configuration** tab.
2. Select **Networks** from the dropdown list and click on the Network ID you believe contains the gateway.
3. Click **Discover Gateway** and then click **OK**.
4. LightRules lists the serial numbers of all found gateways. Compare the quantity of serial numbers and the serial number strings to the information displayed on the All Networks screen:
 - (A) If the quantity of serial numbers is the same, and the strings are the same, then no new gateways have been discovered. Verify proper hardware installation.
 - (B) If the quantity of serial numbers is the same, but the strings are different, then a gateway has been replaced with a new device.
 - (C) If the quantity of serial numbers is greater, then a gateway has been added.
5. For (B) and (C), the map file needs to be updated. Use [Commissioner software](#) to update the map file.

Discover a New Keypad

1. Click the **Configuration** tab.
2. Select **Keypads** from the dropdown list.
3. Click **Discover Keypads** and then click **OK**.
4. LightRules indicates a newly discovered keypad (return to step 2 if no keypads are discovered).
5. The map file needs to be updated. Use [Commissioner software](#) to update the map file.

Discover a New Power Gateway

1. Click the **Configuration** tab.
2. Select **Power Gateways** from the dropdown list.

3. Click **Discover Power Gateways** and then click **OK**.
4. LightRules indicates a newly discovered power gateway (return to step 2 if no keypads are discovered).
5. The map file needs to be updated. Use [Commissioner software](#) to update the map file.

Chapter Ten:

Add-on Features

LightRules Add-on Features

Introduction - what they are, how they enhance the LightRules experience, how to purchase.

LightRules Power is non-lighting electrical load metering equipment that is purchased, installed, and integrated with LightRules. Without a license key, LightRules will display Power functionality in the user interface, but the system will not

collect or report on Power data.

LightRules keypads are wall-mounted controllers with eight configurable buttons. When a user presses button 1-8, the keypad triggers the assigned manual profile. Typically one keypad per room in the facility is sufficient.

LightRules Power



User Considerations: LightRules Power configuration features require **Operations or Administration** "User Permissions" (see page 15).

LightRules Power is non-lighting electrical load metering equipment that is purchased, installed, and integrated with LightRules. Without a license key, LightRules will display Power functionality in the user interface, but the system will not collect or report on power data.

Working with LightRules Power

Configuration in Commissioner

During LightRules installation, the installer creates a map file. The map file contains all of the configurable settings the system needs to perform manual control, automated control, and reporting. Additionally, the map file contains basic power meter and power gateway information, including serial numbers, IP addresses, MAC addresses, DHCP settings, and physical locations (refer to the Commissioner Admin Guide for details).

Configuration in LightRules

The map file contains device serial numbers, IP addresses, and physical locations. However, each power meter needs to be configured with a group assignment (for reporting purposes, the meters are grouped). This step is done in LightRules.

Create a New Meter Group

LightRules creates energy reports based on how the power meters are grouped together. For example, you can keep each power meter separate by creating a new group for each meter, or, you can group certain meters together so as to aggregate the data.

1. Click the **Configuration** tab.
2. Select **Power Meter Groups** from the dropdown list and then click **New Meter Group**.
3. Enter a Name and Description.
4. Click **Create Power Meter group**.

 **Tip:** When adding or removing power meters or power gateways, the map file must be updated; use Commissioner software to update the map file. However, if you are making changes to the power meter group assignments, Commissioner software is not needed.

Assign a Power Meter to a Meter Group

1. Click the **Configuration** tab.
2. Select **Power Meters** from the dropdown list and then click on the serial number of the power meter you wish to edit.
3. Select the desired meter group from the dropdown menu.
4. Click **Update Power Meter**.

 **Tip:** When adding or removing power meters or power gateways, the map file must be updated; use Commissioner software to update the map file. However, if you are making changes to the power meter group assignments, Commissioner software is not needed.

Move a Power Meter to a Different Meter Group

1. Click the **Configuration** tab.
2. Select **Power Meters** from the dropdown list and then click on the serial number of the power meter you wish to edit.
3. Select the new meter group from the dropdown menu.
4. Click **Update Power Meter**.


 **Tip:** When adding or removing power meters or power gateways, the map file must be updated; use Commissioner software to update the map file. However, if you are making changes to the power meter group assignments, Commissioner software is not needed.

LightRules Power Reporting

LightRules Power Reporting Overview

When LightRules Power is configured, additional energy use and energy cost reports appear in the Reporting menu. Additionally, you can create custom energy use and energy cost reports.

Data is reported according to meter group; if only one piece of electrical equipment is assigned to a group, then data will be reported for just that equipment. If multiple pieces of equipment are assigned to a group, then the aggregate data for that equipment will be reported.

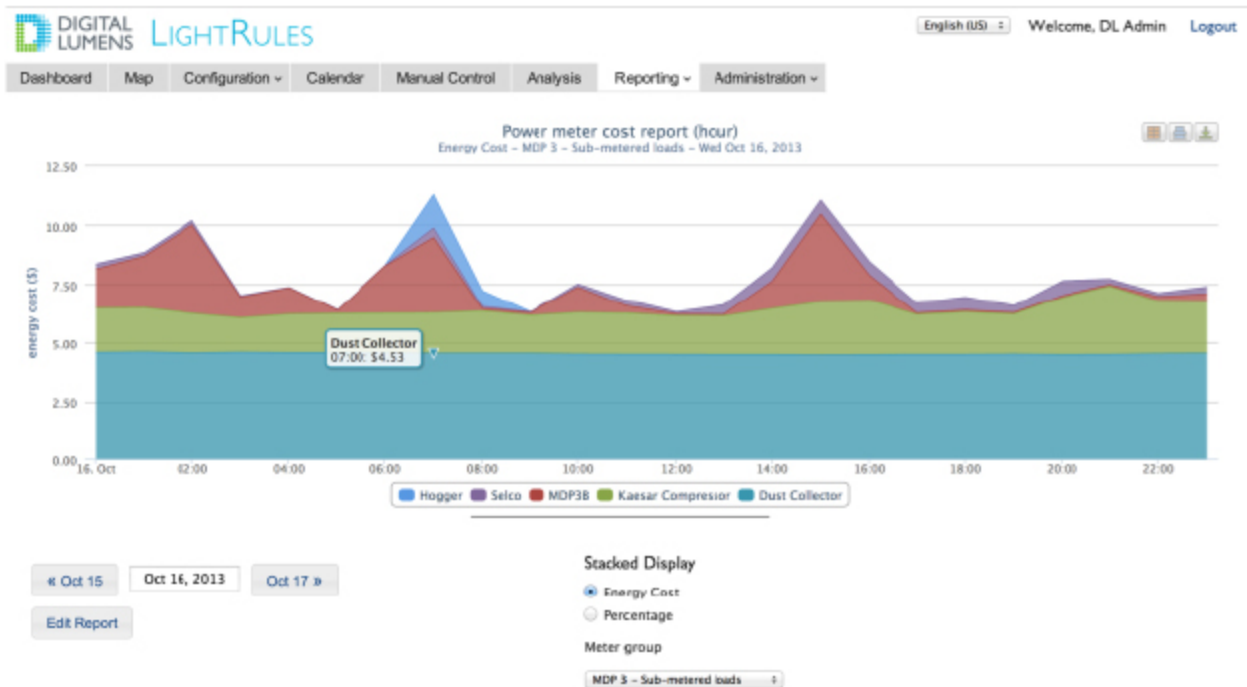

Filter a Report By Meter Group

1. Run a LightRules Power report; for example, "Metered Power - One Day Cost".
2. In the Meter Groups panel of the report screen, select the meter group by which you want to filter results.
LightRules auto-refreshes the results.

Edit a Metered Power Report Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **Edit** for the desired LightRules Power report.
3. Modify one or more of the parameters.
4. (Optional) Check the Favorite box to add the report template to the favorites list on the dashboard.
5. Click **Update Report**.

Create a New Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **New Report**.
3. Select **Metered Power Report**.
4. Type a name for the report.
5. Modify one or more of the parameters.
6. (Optional) Check the Favorite box.
7. Click **Create Report**.

Clone an Existing Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **Clone** for the desired report template.
3. Click **Edit** for the newly created template.
4. Change the report name.
5. Modify one or more the parameters.
6. (Optional) Check the Favorite box to add the report template to the favorites list on the dashboard.
7. Click **Update Report**.

Delete a Metered Report Template

1. Click the **Reporting** tab and select **Manage Reports**.
2. Click **Delete** for the desired report template.
3. Click **OK** to confirm deletion.

LightRules Keypad



User Considerations: Keypad configuration features require **Operations** or **Administration** "User Permissions" (see page 15). Keypads are an optional accessory that allows users to push a lighting profile to a zone or zones of lights from a physical keypad.

LightRules keypads are wall-mounted controllers with eight configurable buttons. When a user presses button 1-8, the keypad triggers the assigned manual profile. Typically one keypad per room in the facility is sufficient.

Working with Keypads

Configuration in Commissioner

During LightRules installation, the installer creates a map file. The map file contains all of the configurable settings LightRules needs to perform manual control, automated control, and reporting. Additionally, the map file contains basic keypad information, including serial numbers, IP addresses, and physical locations (refer to the Commissioner Admin Guide for details).

Configuration in LightRules

Each keypad needs to be configured with manual profile assignments for buttons 1-8. This step is done in LightRules.

When adding or removing keypads, the map file must be updated; use Commissioner software to update the map file. However, if you are making changes to the button assignments, Commissioner software is not needed.

Control a Keypad via LightRules

You can "press" the buttons on any keypad virtually via LightRules:

1. Click the **Configuration** tab.
2. Select **Keypads** from the dropdown list and click on the serial number of the keypad you wish to control.

3. The currently selected button appears highlighted in blue.



4. Click on any button to activate the manual profile associated with that button, as if you were pressing the same button on the actual keypad hardware. The newly selected button will appear highlighted in blue after a few seconds.

Cancel a Keypad-Activated Manual Profile

From the LightRules dashboard, you can cancel any manual profile activated by a keypad:

1. If not viewing the dashboard, click the **Dashboard** tab.
2. In the Active Profiles list, identify the manual profile you wish to cancel.
3. Click the "X" to the left of that manual profile.



4. Click **OK**.

Edit Keypad Button Assignments

Each keypad has eight configurable buttons. Assign a manual profile to each button:

1. Click the **Configuration** tab.
2. Select **Keypads** from the dropdown list and click on the serial number of the keypad you wish to edit.
3. Click **Edit**.



4. For each button, select a manual profile from the dropdown list. You can also leave one or more buttons unassigned.
5. (Optional) To specify a duration, in minutes, use the up and down arrows or type in a number.



Note: If a duration is specified, then the manual profile activated with that button will expire after the specified number of minutes. If no duration is specified ("0"), the manual profile will remain active until canceled.

6. Click **Update Keypad**.

Edit Keypad General Settings

In general, you will use Commissioner software to edit keypad general settings. However, in some instances — for example, an IP address conflict — you may need to edit certain keypad general settings right away.

1. Click the **Configuration** tab.
2. Select **Keypads** from the dropdown list and click on the serial number of the keypad you wish to edit.
3. Click **Edit**.

4. Click Edit again.

Editing Keypad Cold Storage I

Name	Keypad Cold Storage 1
Serial Number	74000944
Keypad type	Philips Ethernet Controller Keypad
Keypad model	103-000023-00
IP Address	192.168.1.23
Description	Located adjacent to door #12.

5. Edit the keypad name, description, or IP address.
6. Click **Update Keypad**.

Chapter Eleven:

Example Cases

Example Cases

The following sections provide example cases for working with various parts of LightRules:

Calendar Example Cases

Example Case 1: Scheduling Lights to All On

On a recurring basis, it may be necessary to set all lights to active power level 100 / inactive power level 100 (fully on, no dimming). For example, to accommodate weekly inspection on Friday mornings from 9 am to 11 am, you can schedule a recurring block:

1. Create a new profile.
2. Name the profile "Inspection," or similar.
3. Specify active and inactive power levels of 100 across all zones in the facility.
4. Save the profile and open the calendar.
5. Click and drag to create a block on the calendar, select the "Inspection" profile you just created, and then specify the following settings:
 - Start time: 9:00am
 - End time: 11:00am
 - Repeat option: Every Friday
 - (Optional) Enter an end date.
6. Save the block.

Example Case 2: Scheduling Weekend Night Lights

Night lights never turn completely off — they dim when not in use, creating spatial reference points within large rooms where the other lights are off. Night lights are also useful for illuminating cross-aisles.

On the weekends when there is less building occupancy, turning down night lights can reduce energy consumption.

General Steps for Scheduling Weekend Night Lights:

1. Create a new profile.
2. Re-name the profile Weekend Night Lights, or similar.
3. Using a known value that is acceptable, specify an inactive power level lower than the existing setting across some or all zones containing night lights.



Note: To identify a safe and acceptable inactive power level, test settings first by creating and running a manual profile.

4. Save the profile and open the calendar.
5. Click and drag to create a block on the calendar, select the "Weekend Night Lights" profile you just created and then specify the following settings:
 - Start time: 12:00 am
 - End time: 12:00 am
 - Repeat option: Every Saturday and every Sunday.
6. (Optional) Enter an end date.
7. Save the block.

Example Case 3: Scheduling Maintenance in One Room for the Following Week

Use the following steps to, for example, schedule a period of maintenance in one room for each weekday in the following week.

General Steps for Scheduling Maintenance:

1. Clone the weekday full occupancy profile and rename it "Maintenance," or similar.
2. For zones that are located in the desired room, adjust the light power levels to override the occupancy sensor: set both the active and inactive power levels to 100.
3. Save the profile and open the calendar.
4. Click and drag to create a block on Monday of the following week, and then select the **Maintenance** profile you just created.
5. Select the Repeating Weekdays option and then check Mon, Tue, Wed, Thu, and Fri.
6. Save the block.

Configuration Example Cases

Example Case 1: Designing Profiles

Think about occupancy on weekdays versus weekends and also occupancy by shift. Design profiles accordingly.

For example, create profiles with the night lights inactive power level turned down. Similarly, you can adjust occupancy sensor delays to match the lower occupancy.

Guidelines for Designing and Editing Profiles

- Create and schedule profiles for weekdays versus weekends.
- Create and schedule profiles according to the time of day / shift.

- Create and schedule holiday profiles.

Example Case 2: Designing Zones

Be thoughtful when creating or editing the zones in each area of the facility. Think about the way each area of the facility is used and design the zones accordingly.

For example, to create visual cues corresponding to the beginning and end of each aisle (where the rest of the lights are off if there is no occupancy), create zones for those areas when the lights are configured as night lights. Similarly, create a zone with night lights if there is a cross-aisle running through the middle of a warehouse area.

Guidelines for Designing and Editing Zones


- Create night light zones at the beginning and end of each aisle.
- If there are cross-aisles, create night light zones containing the lights in those cross-aisles.
- In freezer areas, or any areas with low occupancy, create zones with shorter occupancy sensor delays.
- In busy warehouse storage areas, or any area with high occupancy, create zones with longer occupancy sensor delays.

Example Case 3: Typical Profiles

A profile is a list of rules for some or all configured zones. To take effect, the profile must be pushed manually or scheduled as a block in the calendar. The following examples are of typical profiles and their assigned rules.


Normal Operations Profile

Profile	Normal Operations			Backshift			Maintenance		
	Zone 1	Zone 2	Zone 3	Zone 1	Zone 2	Zone 3	Zone 1	Zone 2	Zone 3
Active	100	100	100	80	80	80	100	100	100
Inactive	0	5	20	0	0	0	30	30	30
Sensor Delay	60	30	180	30	30	30	300	300	300

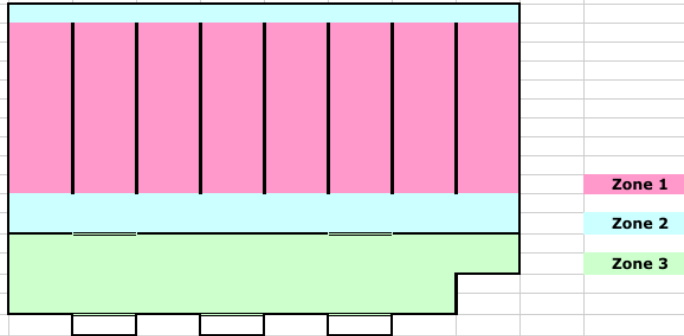

Backshift Profile

Profile	Normal Operations			Backshift			Maintenance		
	Zone 1	Zone 2	Zone 3	Zone 1	Zone 2	Zone 3	Zone 1	Zone 2	Zone 3
Active	100	100	100	80	80	80	100	100	100
Inactive	0	5	20	0	0	0	30	30	30
Sensor Delay	60	30	180	30	30	30	300	300	300

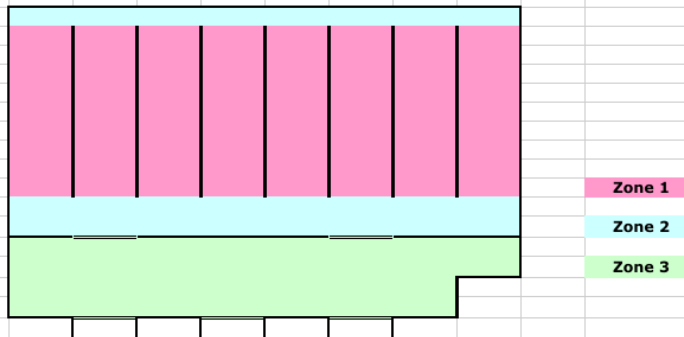

Maintenance Profile

Profile	Normal Operations			Backshift			Maintenance		
	Zone 1	Zone 2	Zone 3	Zone 1	Zone 2	Zone 3	Zone 1	Zone 2	Zone 3
Active	100	100	100	80	80	80	100	100	100
Inactive	0	5	20	0	0	0	30	30	30
Sensor Delay	60	30	180	30	30	30	300	300	300

Manual Control Example Cases

Example Case 1: Temporarily Turning Lights All On

For an unscheduled event, you wish to temporarily set all lights to active power level 100 and inactive power level 100 (all lights fully on, without any dimming):

1. Clone the default profile.
2. Create a logical name like: "Entire Facility, all lights ON 100" , or similar.
3. Across all zones, specify active and inactive power levels of 100, and then run the manual profile.
4. Cancel the manual profile when the event is over.

i **Tip:** Create and save an "all lights ON 100" manual profile for future use. Then, activate the manual profile when needed so you don't have to spend time performing setup.

Example Case 2: Power Limiting

Power limiting enables a facility to drop a portion of the wattage used by the lighting system. For example, during summer months when HVAC compressors are running at high levels, reducing the active power level of all lights (for example, from 100 to 90) is an effective way to temporarily limit total facility power consumption. This practice may be especially beneficial when a facility is facing

peak demand surcharges or demand-response calls from electrical utilities.

Use the following method to perform power limiting:

- First test and determine minimum safe/satisfactory illumination levels.
- Create a manual profile with the tested settings for use at a later time.
- Run the manual profile when facing peak demand surcharges or a demand-response call occurs.

General Steps for Power Limiting

1. Create and activate a manual profile a portion of the facility that reduces the active power level, starting with a reduction of 10.
2. Using a light meter, evaluate the new illumination level. Make sure that new illumination level is adequate to meet facility operations safety requirements.
3. If the illumination level is adequate, try reducing the active power level by another 5 and then re-evaluate.

Repeat the process until the maximum reduction is achieved.



Tip: Click the gang toggle next to multiple zones, and then use a single slider to make simultaneous changes across those zones (instead of changing them one-by-one).

4. Apply the final settings across all zones.
5. Activate the manual profile for a measurable period of time and then run LightRules reports to compare the reduction in both energy use and cost.
6. Save the manual profile and energy metrics for future use.

Example Case 3: Fine-tuning Night Lights to Improve the Facility's Energy Efficiency

Most LightRules facilities use night lights. Night lights never turn completely off — they dim when not in use, creating spatial reference points within large rooms where some or all of the other lights are off. Night lights are also useful for partially illuminating cross-aisles in large warehouse areas.

General Steps for Fine-Tuning Night Lights

In some instances, you can reduce the amount of light produced by night lights, so as to improve your facility's energy efficiency:

1. Create a manual profile that, for example, reduces the night lights' inactive power level from 30 to 20.
2. During facility downtime, activate the manual profile and evaluate the new settings, using a light meter.
Make sure that new light levels are adequate to meet facility operations safety requirements.

3. Tune the manual profile until the inactive power level is desirable. Record the new rule settings.
4. Create and block a scheduled profile that automatically uses triggers new night light settings.

For additional details about night lights, see Example Case 2: Scheduling Weekend Night Lights".

Reporting Example Cases

Example Case 1: Using Reports to Improve the Facility's Energy Efficiency: Active Power

Every zone has an active power level setting. You can improve your facility's energy efficiency by identifying areas with low occupancy and adjusting the active power rule for those zones.

General Steps for Tuning the Active Power Level in a Low-Occupancy Area

1. Run a One Month Occupancy report and look for patterns showing low occupancy. For example, look for certain days of the week that have substantially lower occupancy levels.
2. Run a One Day Occupancy report and look for hours of the day where the occupancy levels are lower.
3. Based on the information gathered in steps 1 and 2, note any patterns of low occupancy.
4. Validate with facility operations that the patterns in fact correspond to lower occupancy.
5. Create a manual profile that, for example, reduces the active power level setting from 100 to 90.
6. During facility downtime, or preferably during an actual time period as identified in steps 1-4, activate the manual profile and evaluate the illumination level using a light meter.
7. Tune the manual profile until the active power level setting is desirable. Record the new setting.
8. Create and schedule a profile for the time periods identified in steps 1-4, and then apply the active power level setting recorded in step 7.

Example Case 2: Using Reports to Improve the Facility's Energy Efficiency: Sensor Delay

Every zone has a sensor delay setting that specifies the delay used by a light before that light switches to the inactive power level. You can improve the facility's energy efficiency by identifying areas with low occupancy and adjusting the sensor delay setting for that zone.

General Steps for Tuning the Sensor in a Low-Occupancy Area

1. Run a One Month Occupancy report and look for patterns showing low occupancy. For example, look for certain days of the week that have substantially lower occupancy levels.

2. Run a One Day Occupancy report and look for certain hours of the day where the occupancy levels are substantially lower.
3. Based on the information gathered in steps 1 and 2, note the patterns of low occupancy.
4. Validate with facility operations that the patterns in fact correspond to lower occupancy.
5. Create a manual profile that, for example, reduces the sensor delay from 1 minute down to 30 seconds.
6. During facility downtime, or preferably during an actual time period as identified in steps 1-4, activate the manual profile and evaluate the sensor delay setting.
7. Tune the manual profile until the sensor delay setting is desirable. Record the new setting.
8. Create a scheduled profile for the time periods identified in steps 1-4, and apply the sensor delay setting recorded in step 7.

